
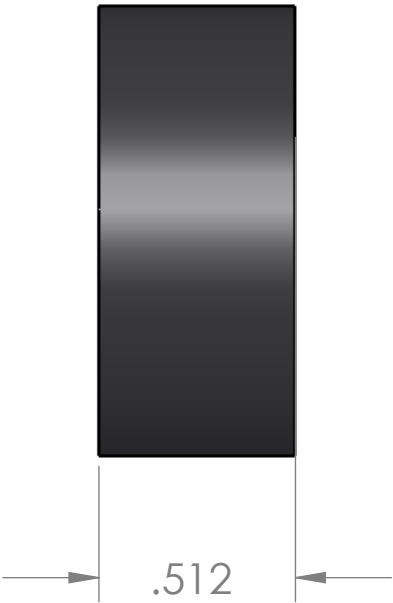


REVISIONS			
REV.	DESCRIPTION	DATE	APPROVED
A	REDRAWN IN SW	2/28/2005	

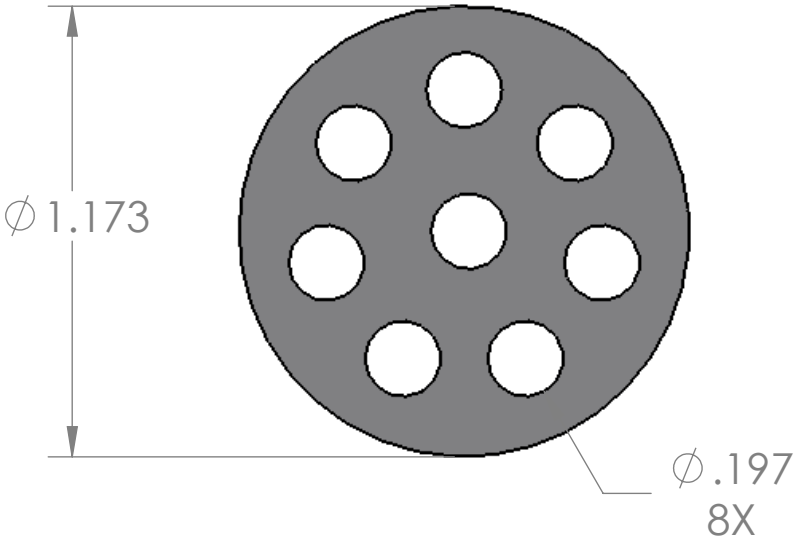

TO OBTAIN IP65 SEAL IN ONE OF THE LISTED CABLE GLANDS, THE O.D. OF THE CABLE MUST BE WITHIN .02" OF THE HOLE DIAMETERS

CAN BE USED IN:	
MCG-29	
MCG-29R	
PCG-29	
PCG-29-B	
PCG-29R	
PCG-29R-B	
PCG-1.0	
PCG-1.0-B	
PCG-1.0R	
PCG-1.0R-B	
PCG-M32	
PCG-M32-B	

MATERIAL:	TPE
-----------	-----

PROPRIETARY AND CONFIDENTIAL
THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF MENCOM CORPORATION. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OF MENCOM CORPORATION IS PROHIBITED.

		UNLESS OTHERWISE SPECIFIED:		NAME	MENCOM CORPORATION		
		DIMENSIONS ARE IN INCHES TOLERANCES: FRACTIONAL ±1/64 ANGULAR: MACH±5° BEND ±5° TWO PLACE DECIMAL ±.01 THREE PLACE DECIMAL ±.004	DRAWN	BEM	TITLE:		
			CHECKED				
			ENG APPR.				
			MFG APPR.				
			Q.A.		SIZE DWG. NO. REV B PG29-8X5 A		
		MATERIAL	COMMENTS:				
		FINISH					
		DO NOT SCALE DRAWING			SCALE: 4:1	WEIGHT:	SHEET 1 OF 1