
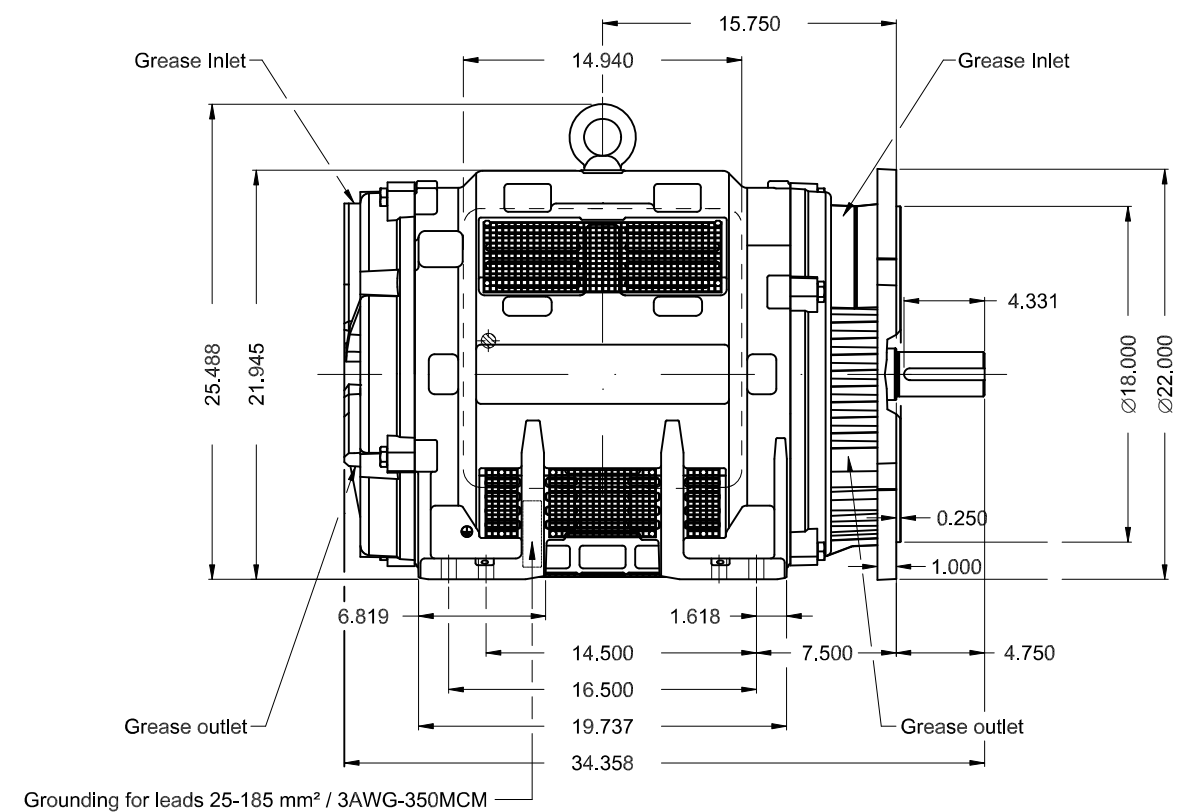


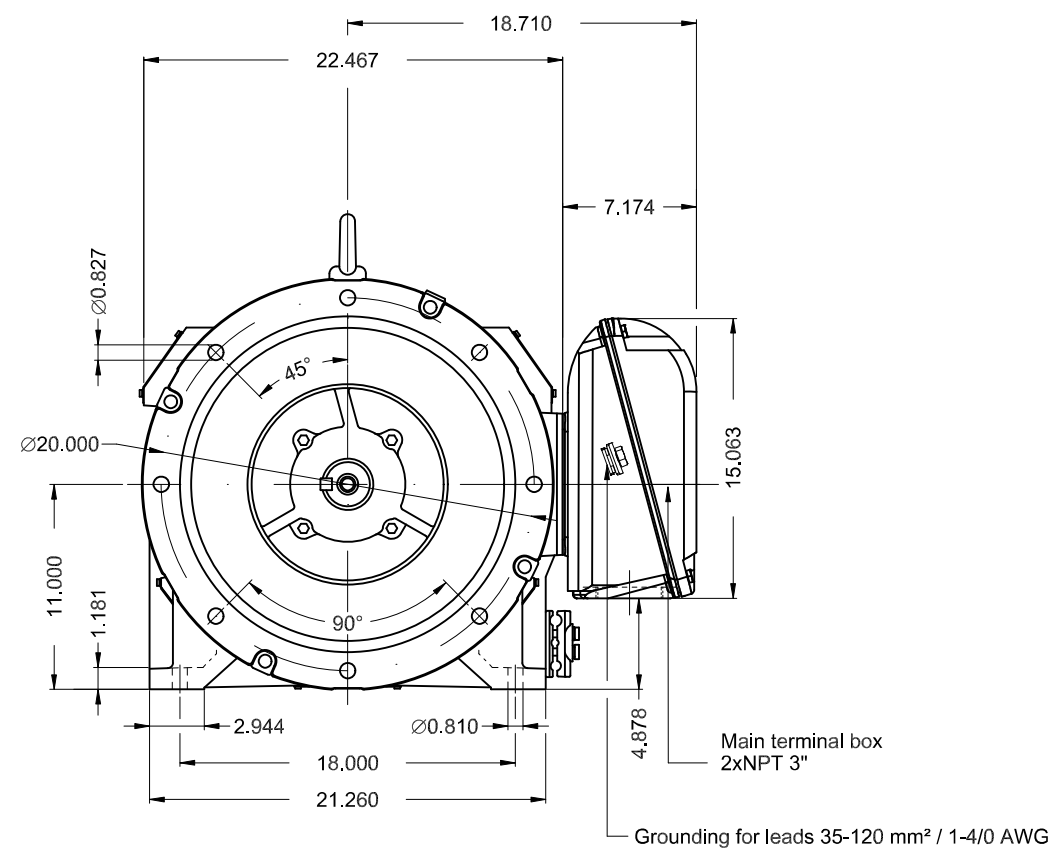

200 HP 04 Poles 60 Hz										A
								1:10		
							HYBRISUSER			00
ECM	LOC	SUMMARY OF MODIFICATIONS					EXECUTED	CHECKED	RELEASED	DATE VER
EXECUTED	HYBRISUSER		THREE PH. MOTOR W40 NEMA PREM. EFF. FRAME 444/5TSD IP23 ODP					PREVIEW WDD 00		
CHECKED										
RELEASED										
REL. DATE		WMO	Jaraguá do Sul		Product Engineering		SHEET	1 / 1		