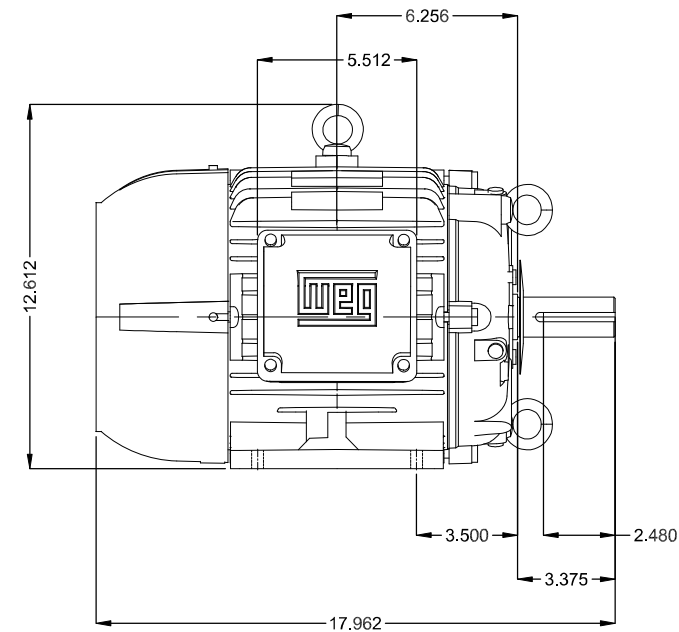


7.5 HP 04 Poles 60 Hz										A
						HYBRISUSER				00
ECM		LOC	SUMMARY OF MODIFICATIONS			EXECUTED	CHECKED	RELEASED	DATE	VER
EXECUTED	HYBRISUSER		THREE PH. MOTOR COOLING TOWER W22 NEMA PREM. EFF. FRAME 213T IP55 TEFC				PREVIEW WDD 00			
CHECKED										
RELEASED										
REL. DATE										
							SHEET		/	