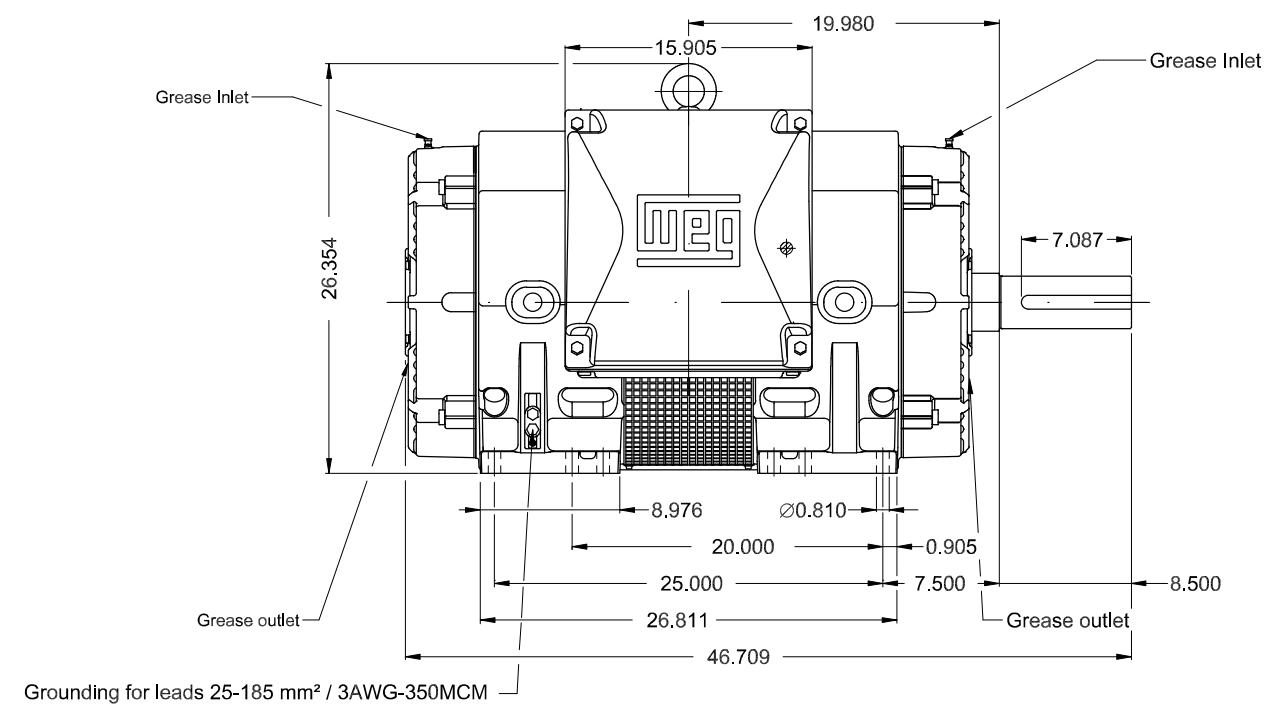
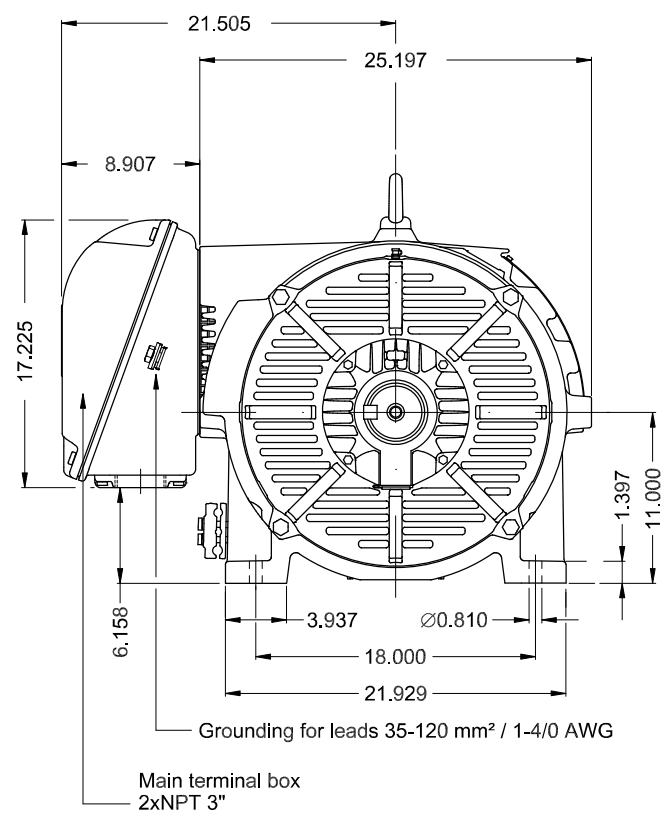


250 HP 06 Poles 60 Hz										A	
										1:12	
							HYBRISUSER				
ECM		LOC	SUMMARY OF MODIFICATIONS				EXECUTED	CHECKED	RELEASED	DATE	VER
EXECUTED	HYBRISUSER		THREE PH. MOTOR W40 NEMA PREM. EFF. FRAME 447/9T IP23 ODP					PREVIEW WDD 00			
CHECKED											
RELEASED											
REL. DATE			WMO	Jaraguá do Sul			Product Engineering		SHEET	1 / 1	