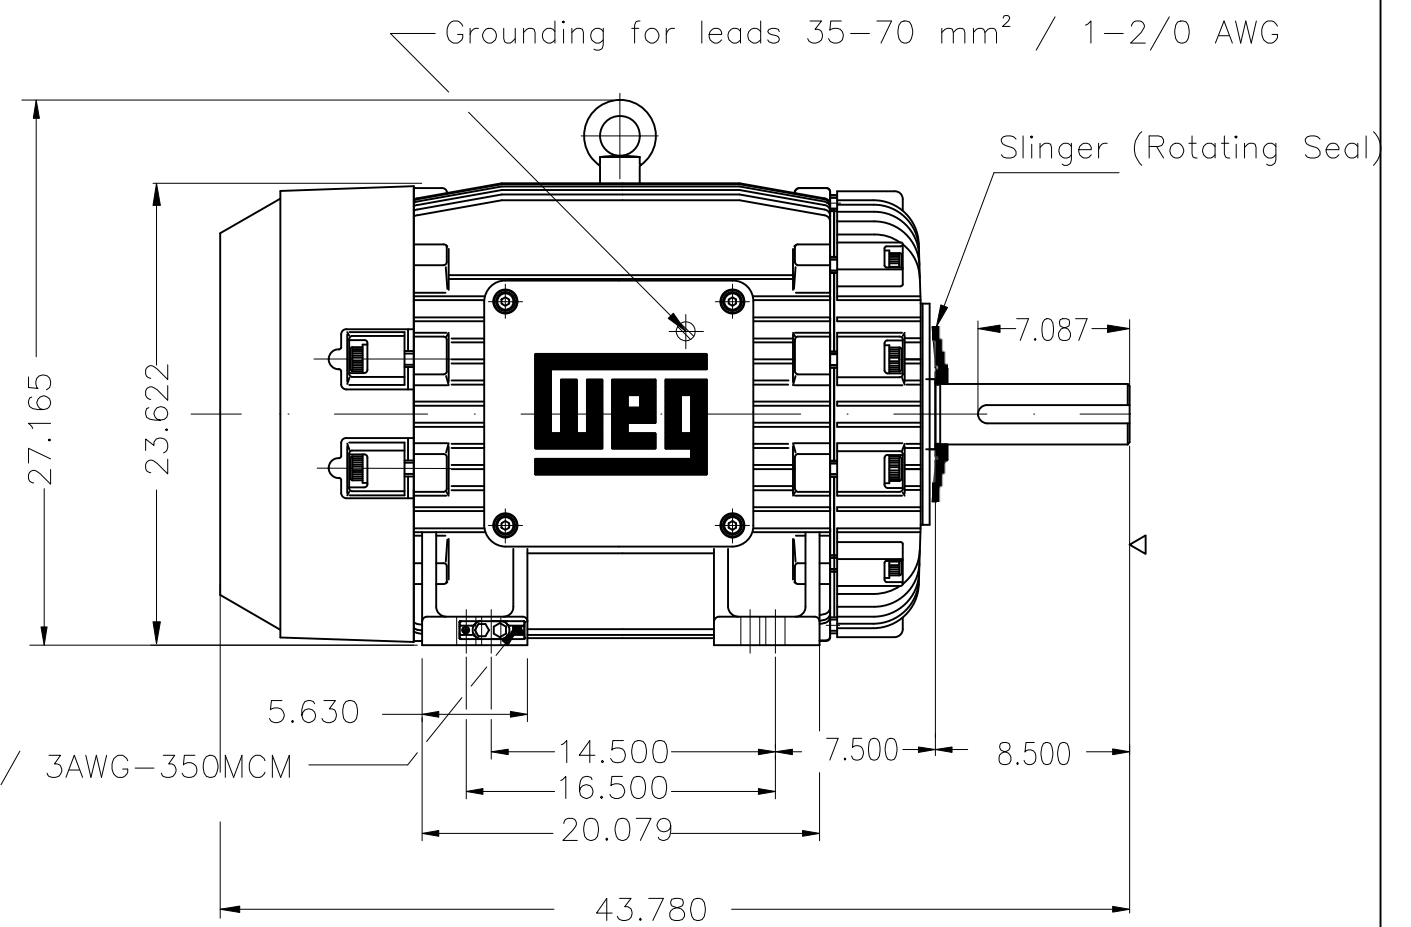
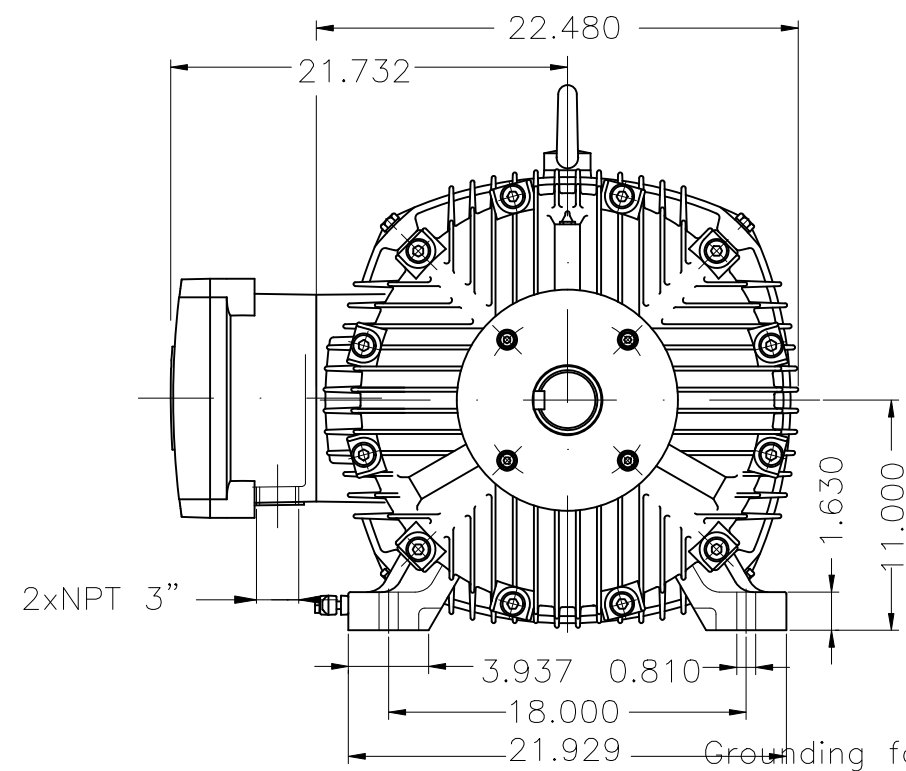


125 HP 04 Poles 60 Hz										A
						HYBRISUSER				00
ECM	LOC	SUMMARY OF MODIFICATIONS				EXECUTED	CHECKED	RELEASED	DATE	VER
EXECUTED	HYBRISUSER		THREE PH. MOTOR EXPLOSION PROOF NEMA PREM. EFF. FRAME 444/5T IP55 TEFC				PREVIEW WDD 00			
CHECKED										
RELEASED										
REL. DATE		WMO	Jaraguá do Sul		Product Engineering	SHEET	1 / 1			