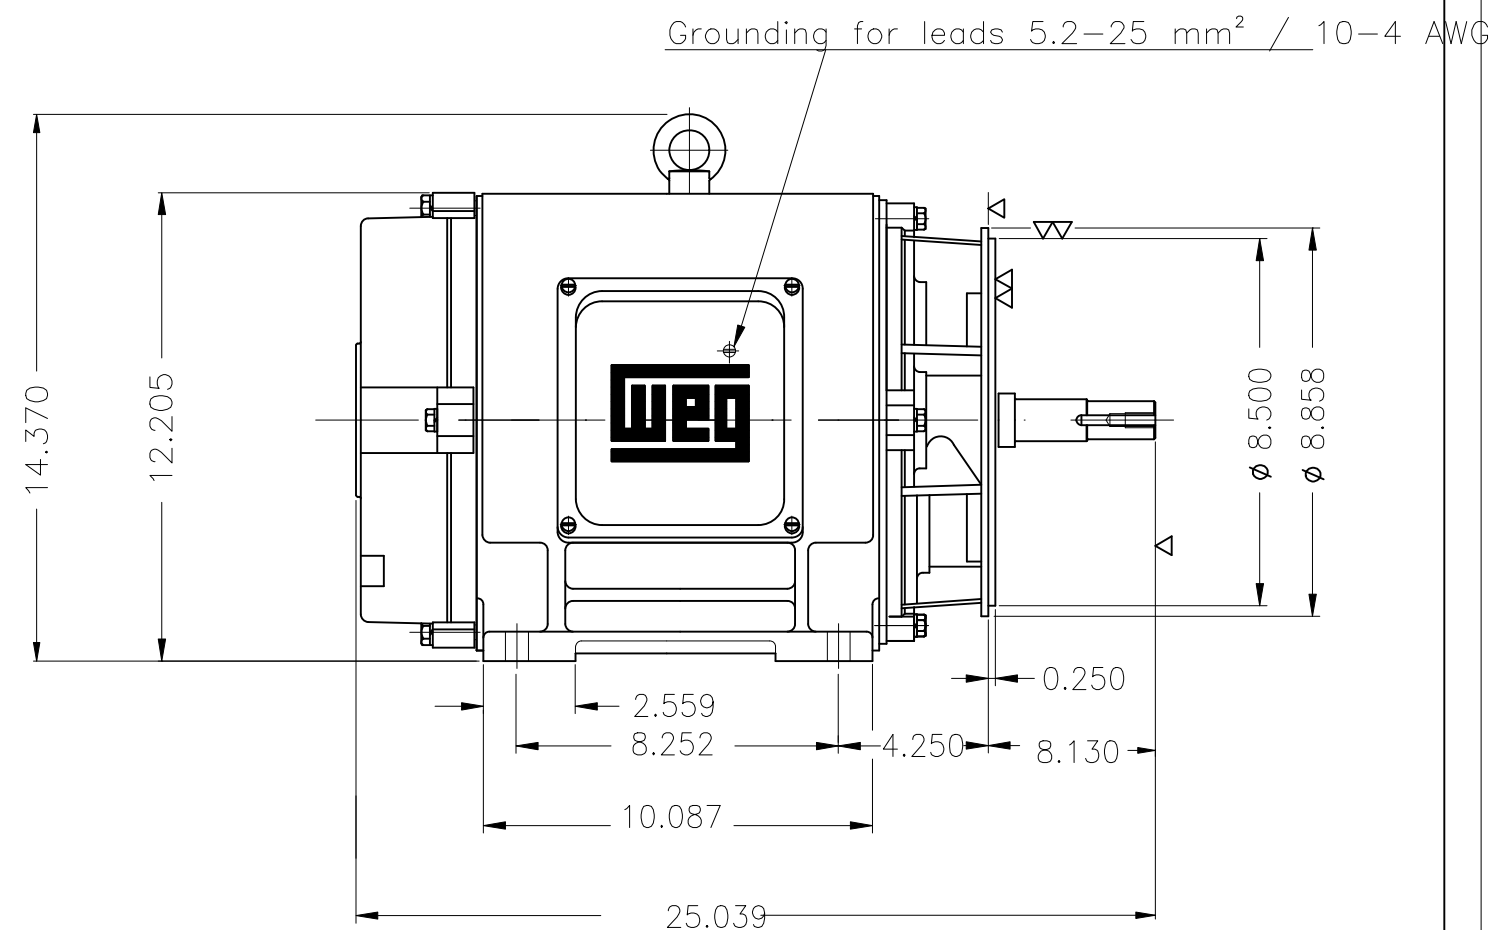
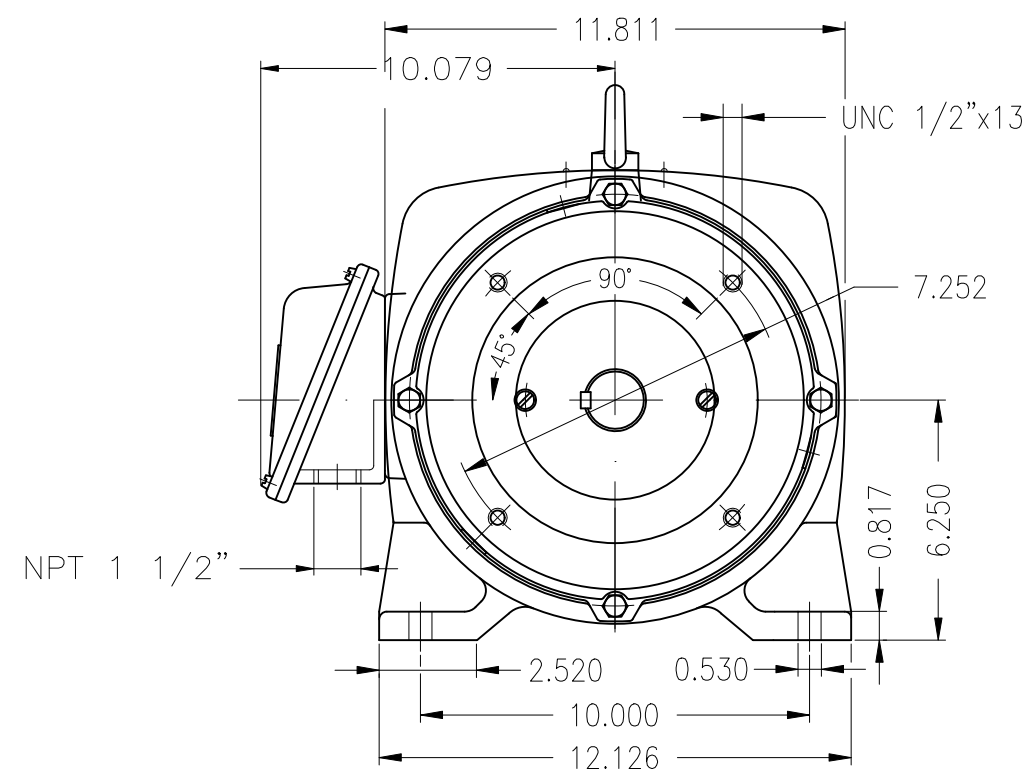


20 HP 02 Poles 60 Hz										A		
							HYBRISUSER				00	
ECM		LOC	SUMMARY OF MODIFICATIONS					EXECUTED	CHECKED	RELEASED	DATE	VER
EXECUTED	HYBRISUSER	 	THREE PH. MOTOR JM/JP/JET PUMP HIGH EFF. FRAME 254JP IP23 ODP					PREVIEW				
CHECKED												
RELEASED												
REL. DATE		WMO	Jaragua do Sul		Product Engineering		SHEET	1	/	1		