
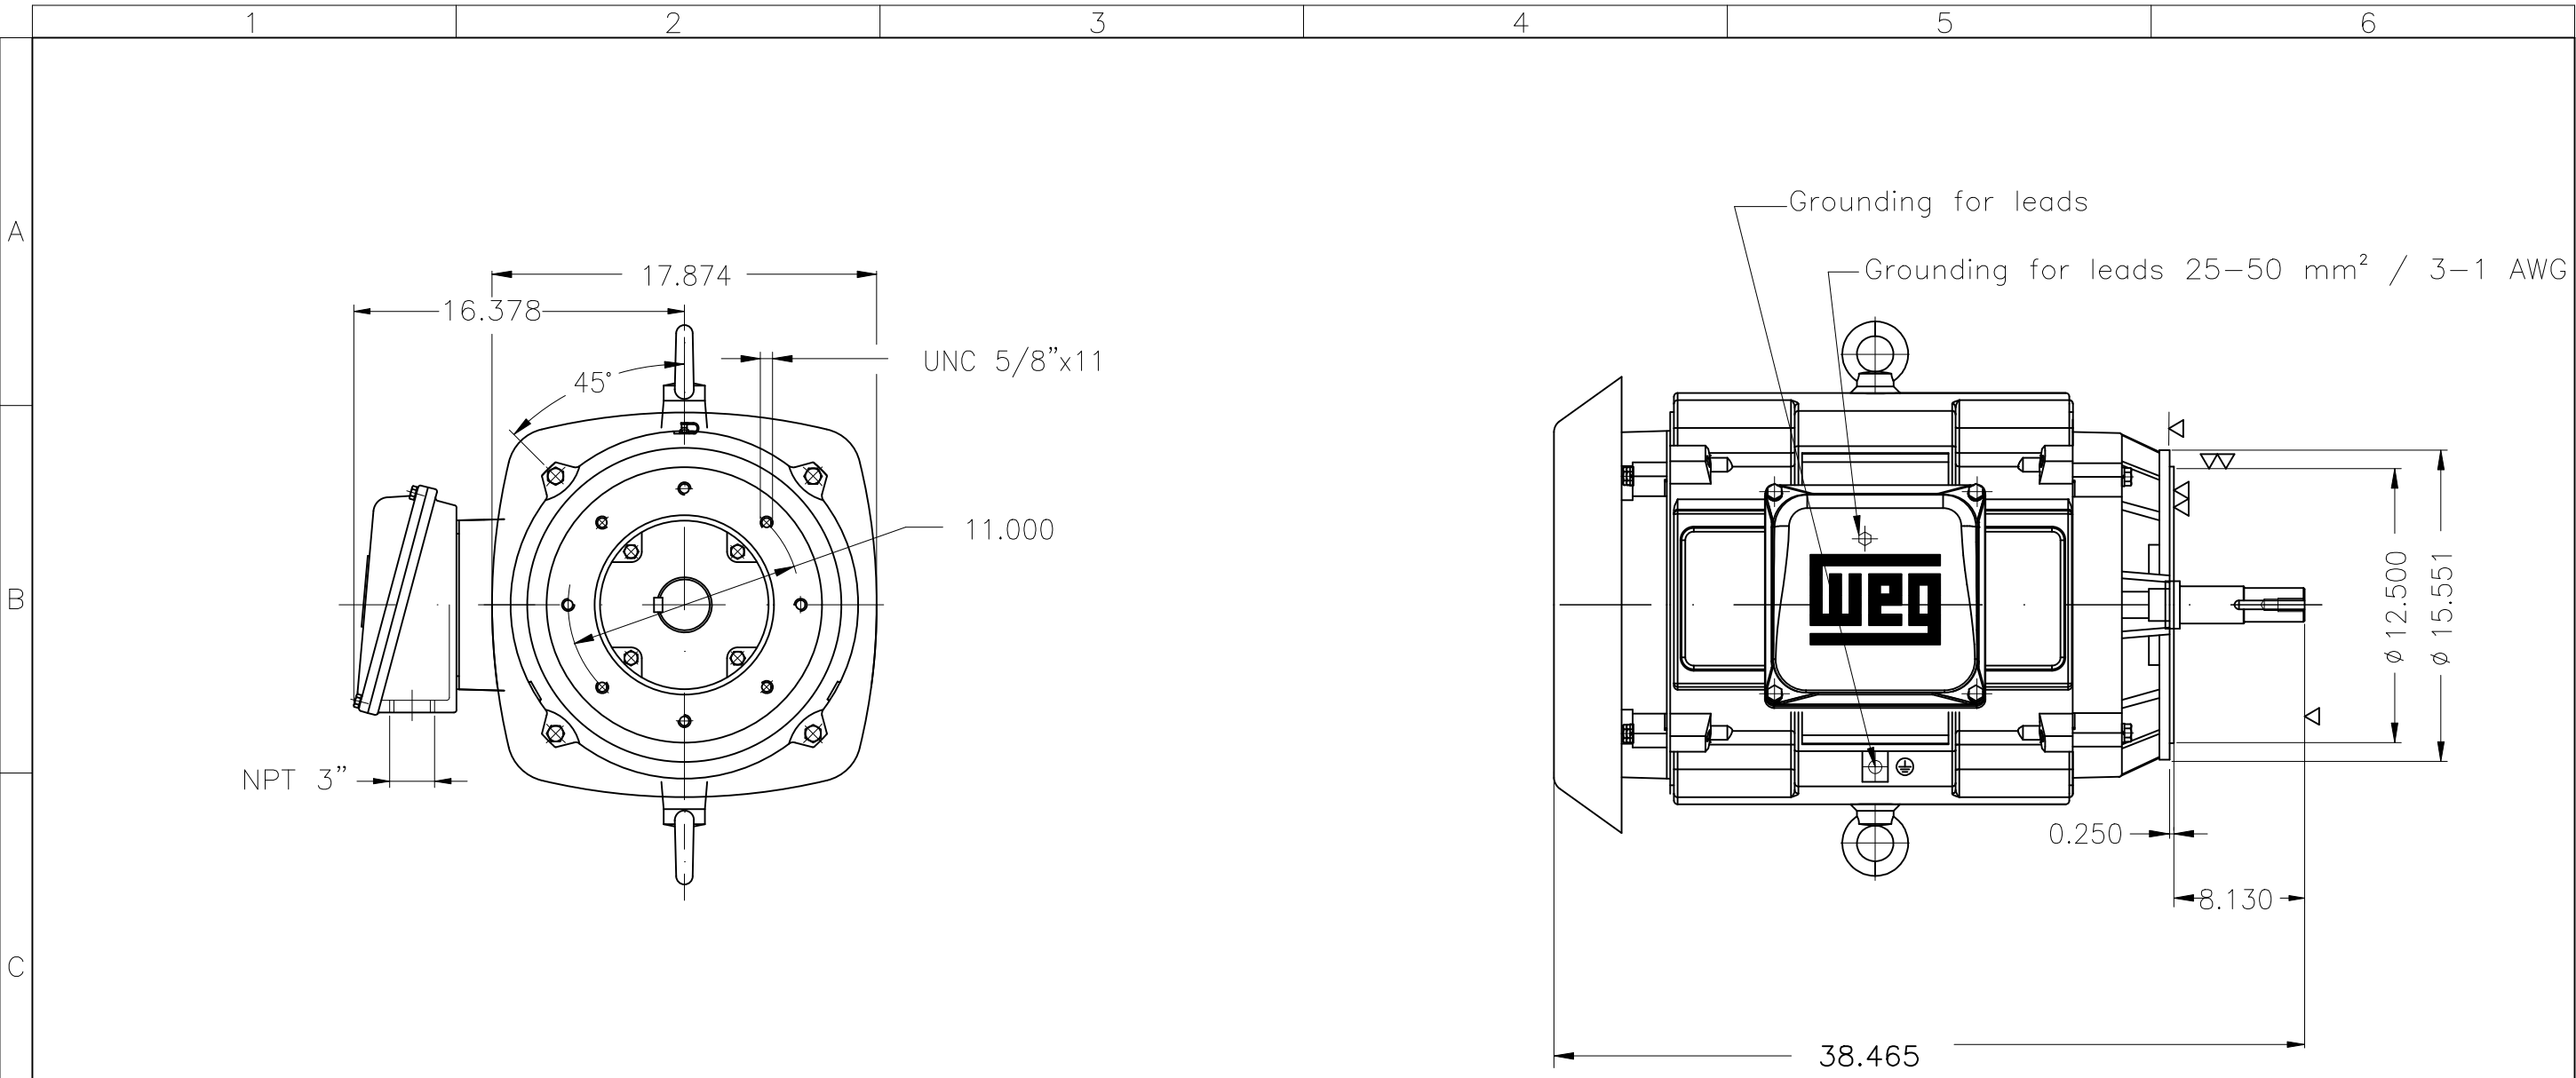




D															
			100 HP 04 Poles 60 Hz										A		
									HYBRISUSER					00	
E			ECM	LOC	SUMMARY OF MODIFICATIONS				EXECUTED	CHECKED	RELEASED	DATE	VER		
			EXECUTED	HYBRISUSER	 THREE PH. MOTOR JM/JP/JET PUMP HIGH EFF. FRAME 404/5JP IP23 ODP				PREVIEW						
			CHECKED						WDD	00					
			RELEASED						SHEET	1 / 1					
			REL. DATE		WMO	Jaragua do Sul	Product Engineering								
Certification UL/FIRE PUMP															
Color RAL 5009															
Painting plan 203A															
Mounting V18															