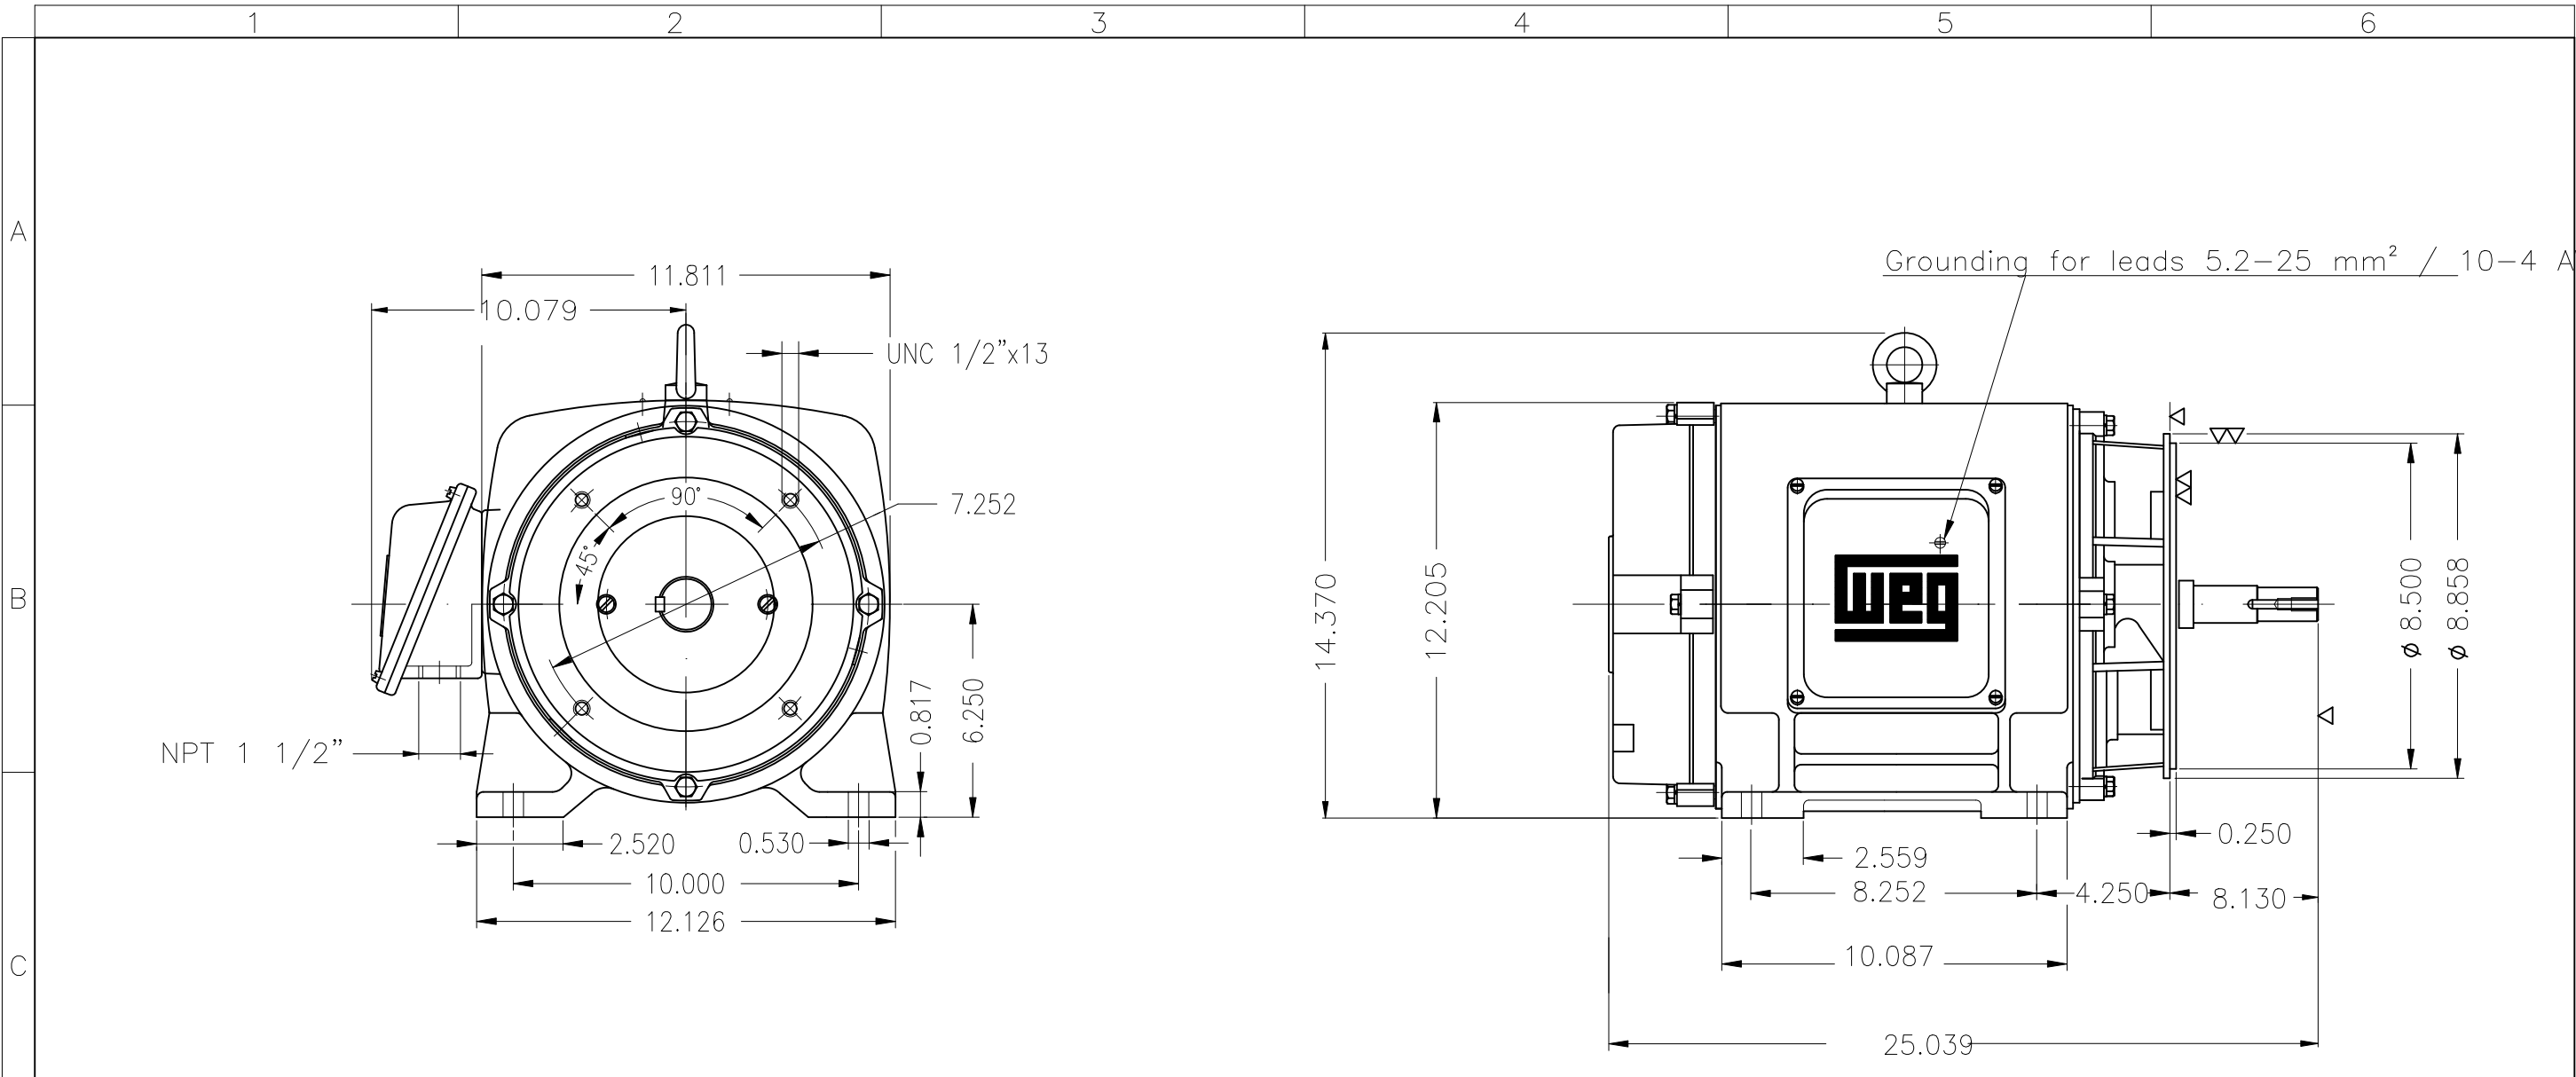


20 HP 02 Poles 60 Hz										A
						HYBRISUSER				00
ECM		LOC	SUMMARY OF MODIFICATIONS			EXECUTED	CHECKED	RELEASED	DATE	VER
EXECUTED	HYBRISUSER	 	THREE PH. MOTOR JM/JP/JET PUMP HIGH EFF.				PREVIEW			
CHECKED			FRAME 254JP IP23 ODP							
RELEASED										
REL. DATE			WMO	Jaragua do Sul		Product Engineering		SHEET	1 / 1	