


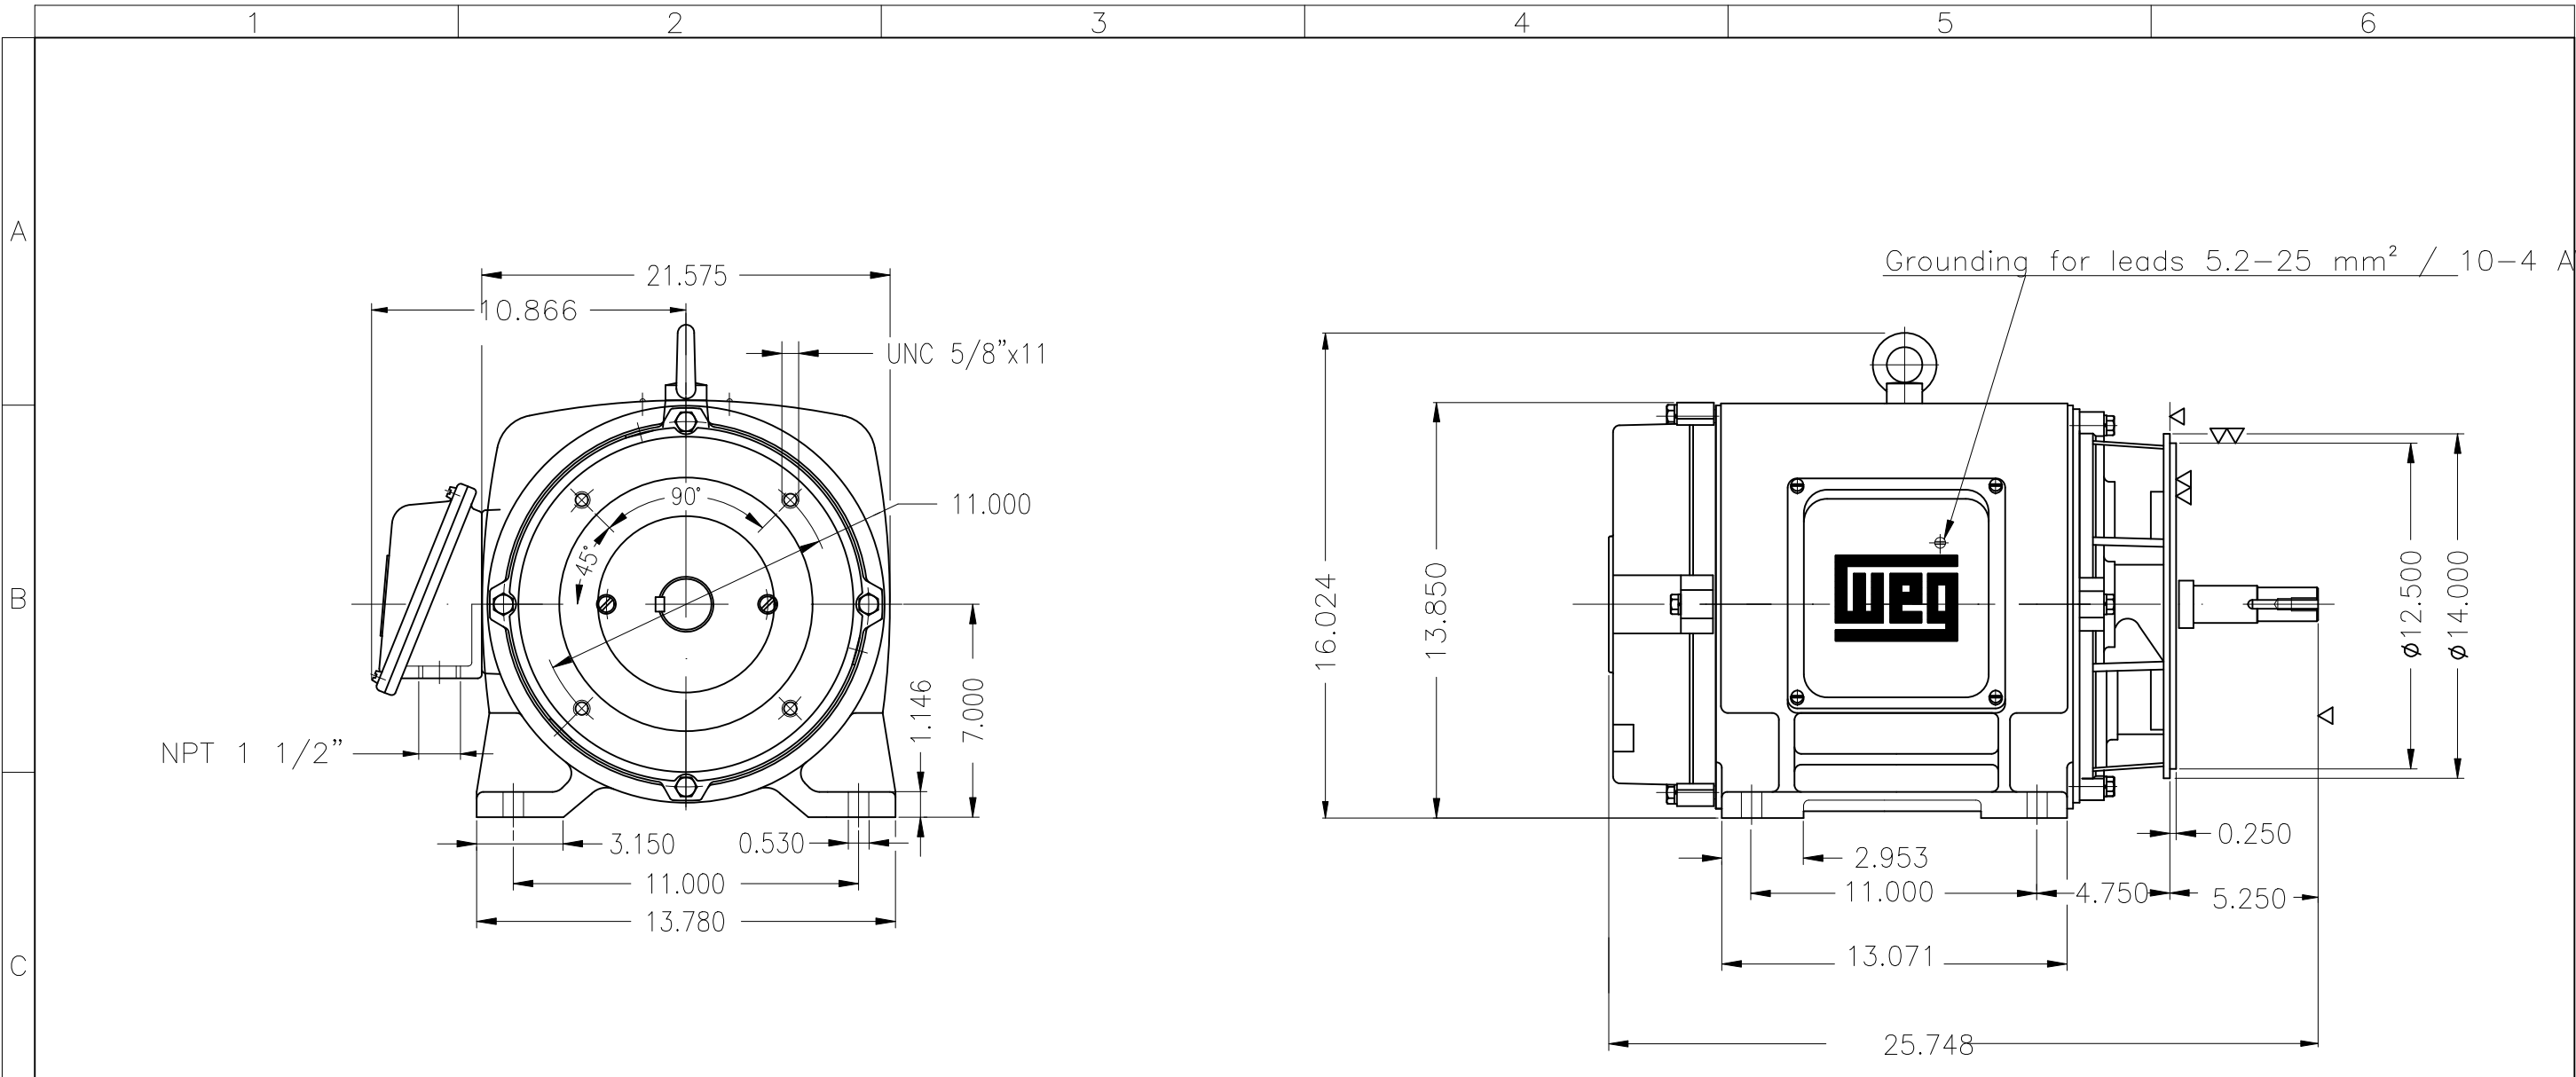

		30 HP 04 Poles 60 Hz		A	
Certification UL/FIRE PUMP		HYBRISUSER		00	
Packing - crate		EXECUTED		CHECKED	
Color RAL 5009		LOC		RELEASED	
Painting plan 203A		SUMMARY OF MODIFICATIONS		DATE	
Mounting B34R(D)		THREE PH. MOTOR JM/JP/JET PUMP HIGH EFF.		VER	
		FRAME 286JM IP23 ODP		PREVIEW	
		REL. DATE		WDD 00	
		WMO Jaragua do Sul		SHEET 1 / 1	
		Product Engineering		WEG	