




A

B

C

D

E

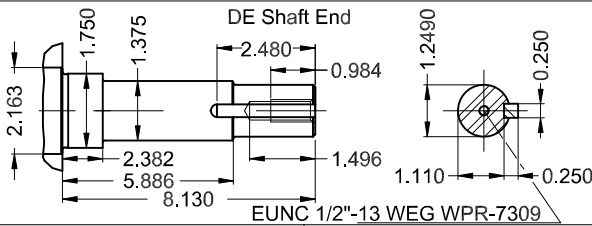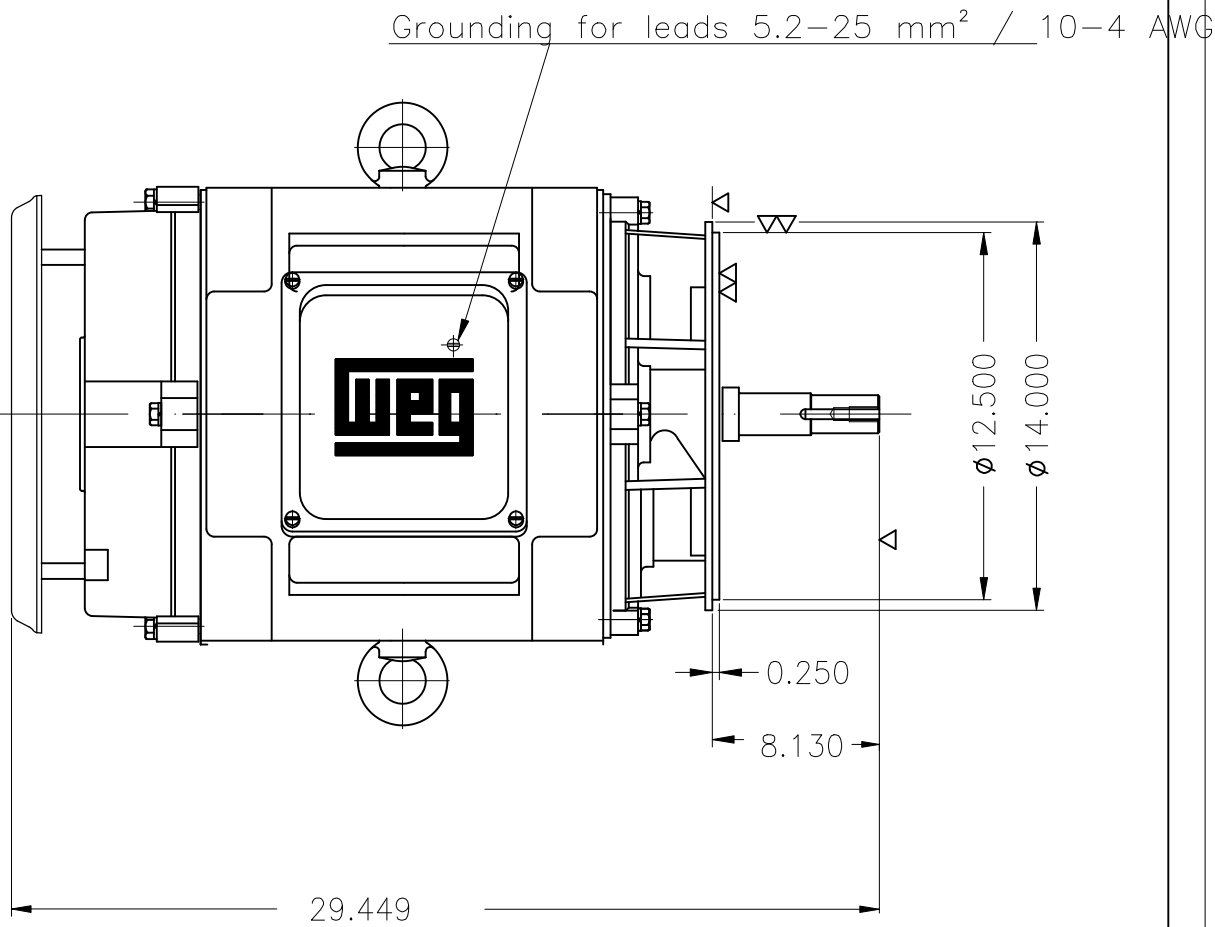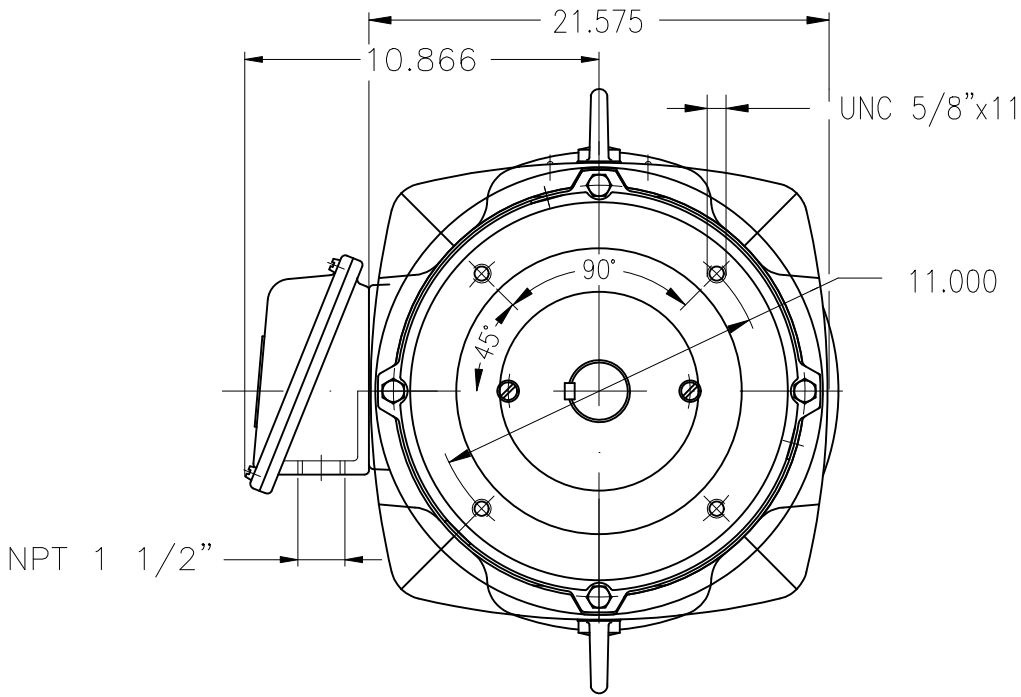

30 HP 02 Poles 60 Hz A

ECM	LOC	SUMMARY OF MODIFICATIONS	EXECUTED	CHECKED	RELEASED	DATE	VER
EXECUTED	HYBRISUSER	THREE PH. MOTOR JM/JP/JET PUMP HIGH EFF.					00
CHECKED		FRAME 284JP IP23 ODP					
RELEASED							
REL. DATE		WMO Jaragua do Sul	Product Engineering	SHEET	1 / 1		

Certification UL/FIRE PUMP
Color RAL 5009
Painting plan 203A
Mounting V18

PREVIEW
WDD 00

