


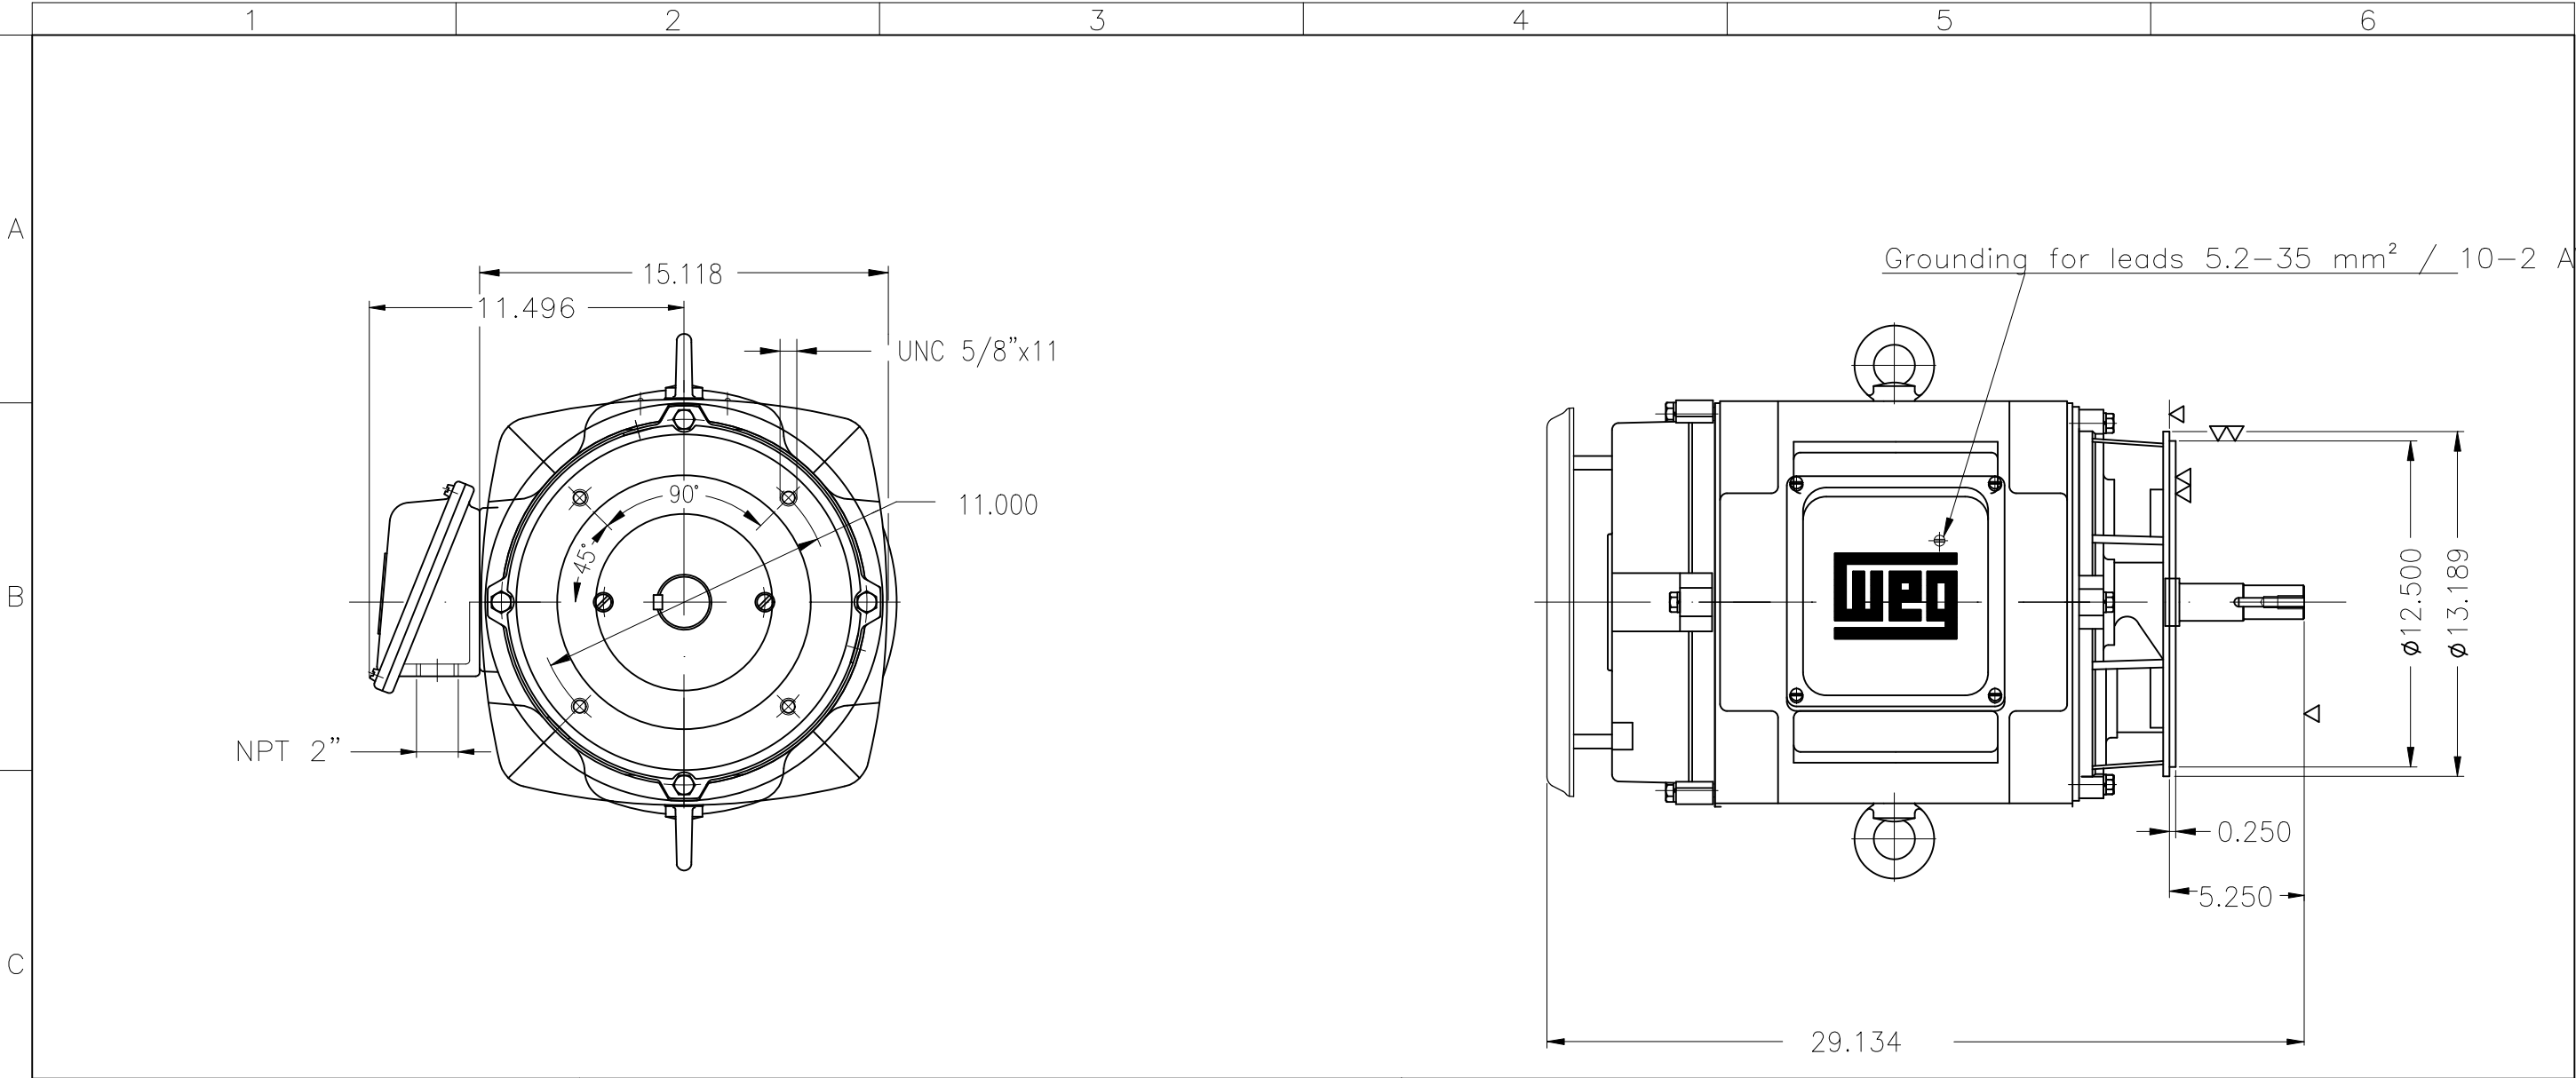

D												
		50 HP 02 Poles 60 Hz										
E							HYBRISUSER					00
	ECM	LOC	SUMMARY OF MODIFICATIONS				EXECUTED	CHECKED	RELEASED	DATE	VER	
	EXECUTED	HYBRISUSER			THREE PH. MOTOR JM/JP/JET PUMP HIGH EFF.			PREVIEW		WDD 00		
	CHECKED				FRAME 324JM IP23 ODP							
	RELEASED											
REL. DATE		WMO	Jaragua do Sul	Product Engineering	SHEET	1 / 1						

Certification UL/FIRE PUMP

Color RAL 5009

Painting plan 203A

Mounting V18