


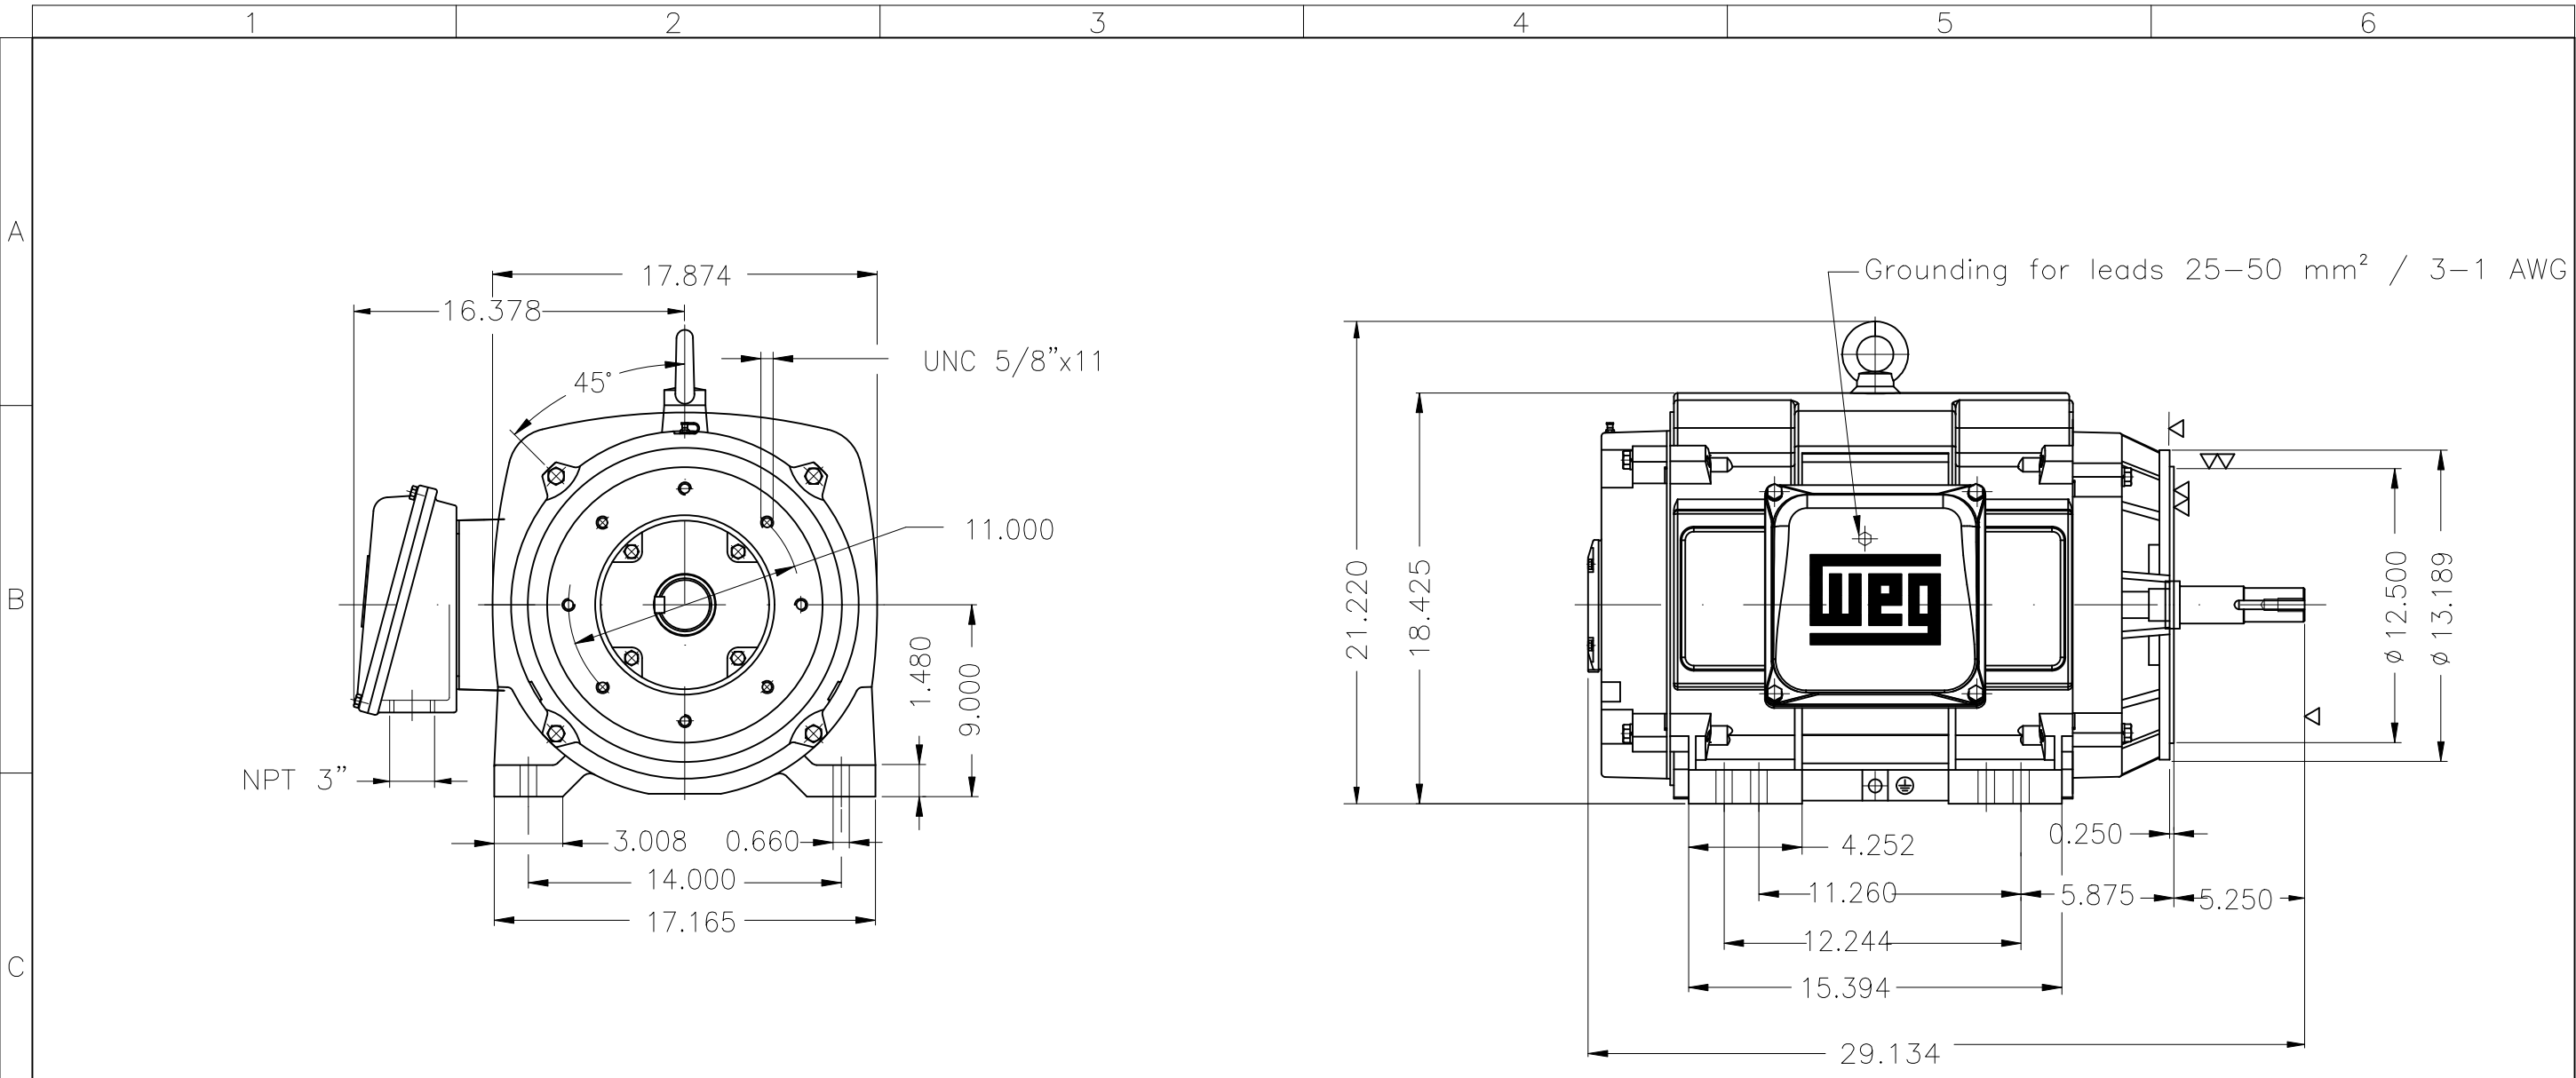

D																
					75 HP 02 Poles 60 Hz										A	
E																
Certification UL/FIRE PUMP						ECM		LOC	SUMMARY OF MODIFICATIONS			EXECUTED	CHECKED	RELEASED	DATE	VER
Color RAL 5009						EXECUTED		HYBRISUSER			THREE PH. MOTOR JM/JP/JET PUMP HIGH EFF.			PREVIEW		
Painting plan 203A						CHECKED					FRAME 364/5JM IP23 ODP					
Mounting B34R(D)						RELEASED										
						REL. DATE			WMO		Jaragua do Sul		Product Engineering		SHEET 1 / 1	