


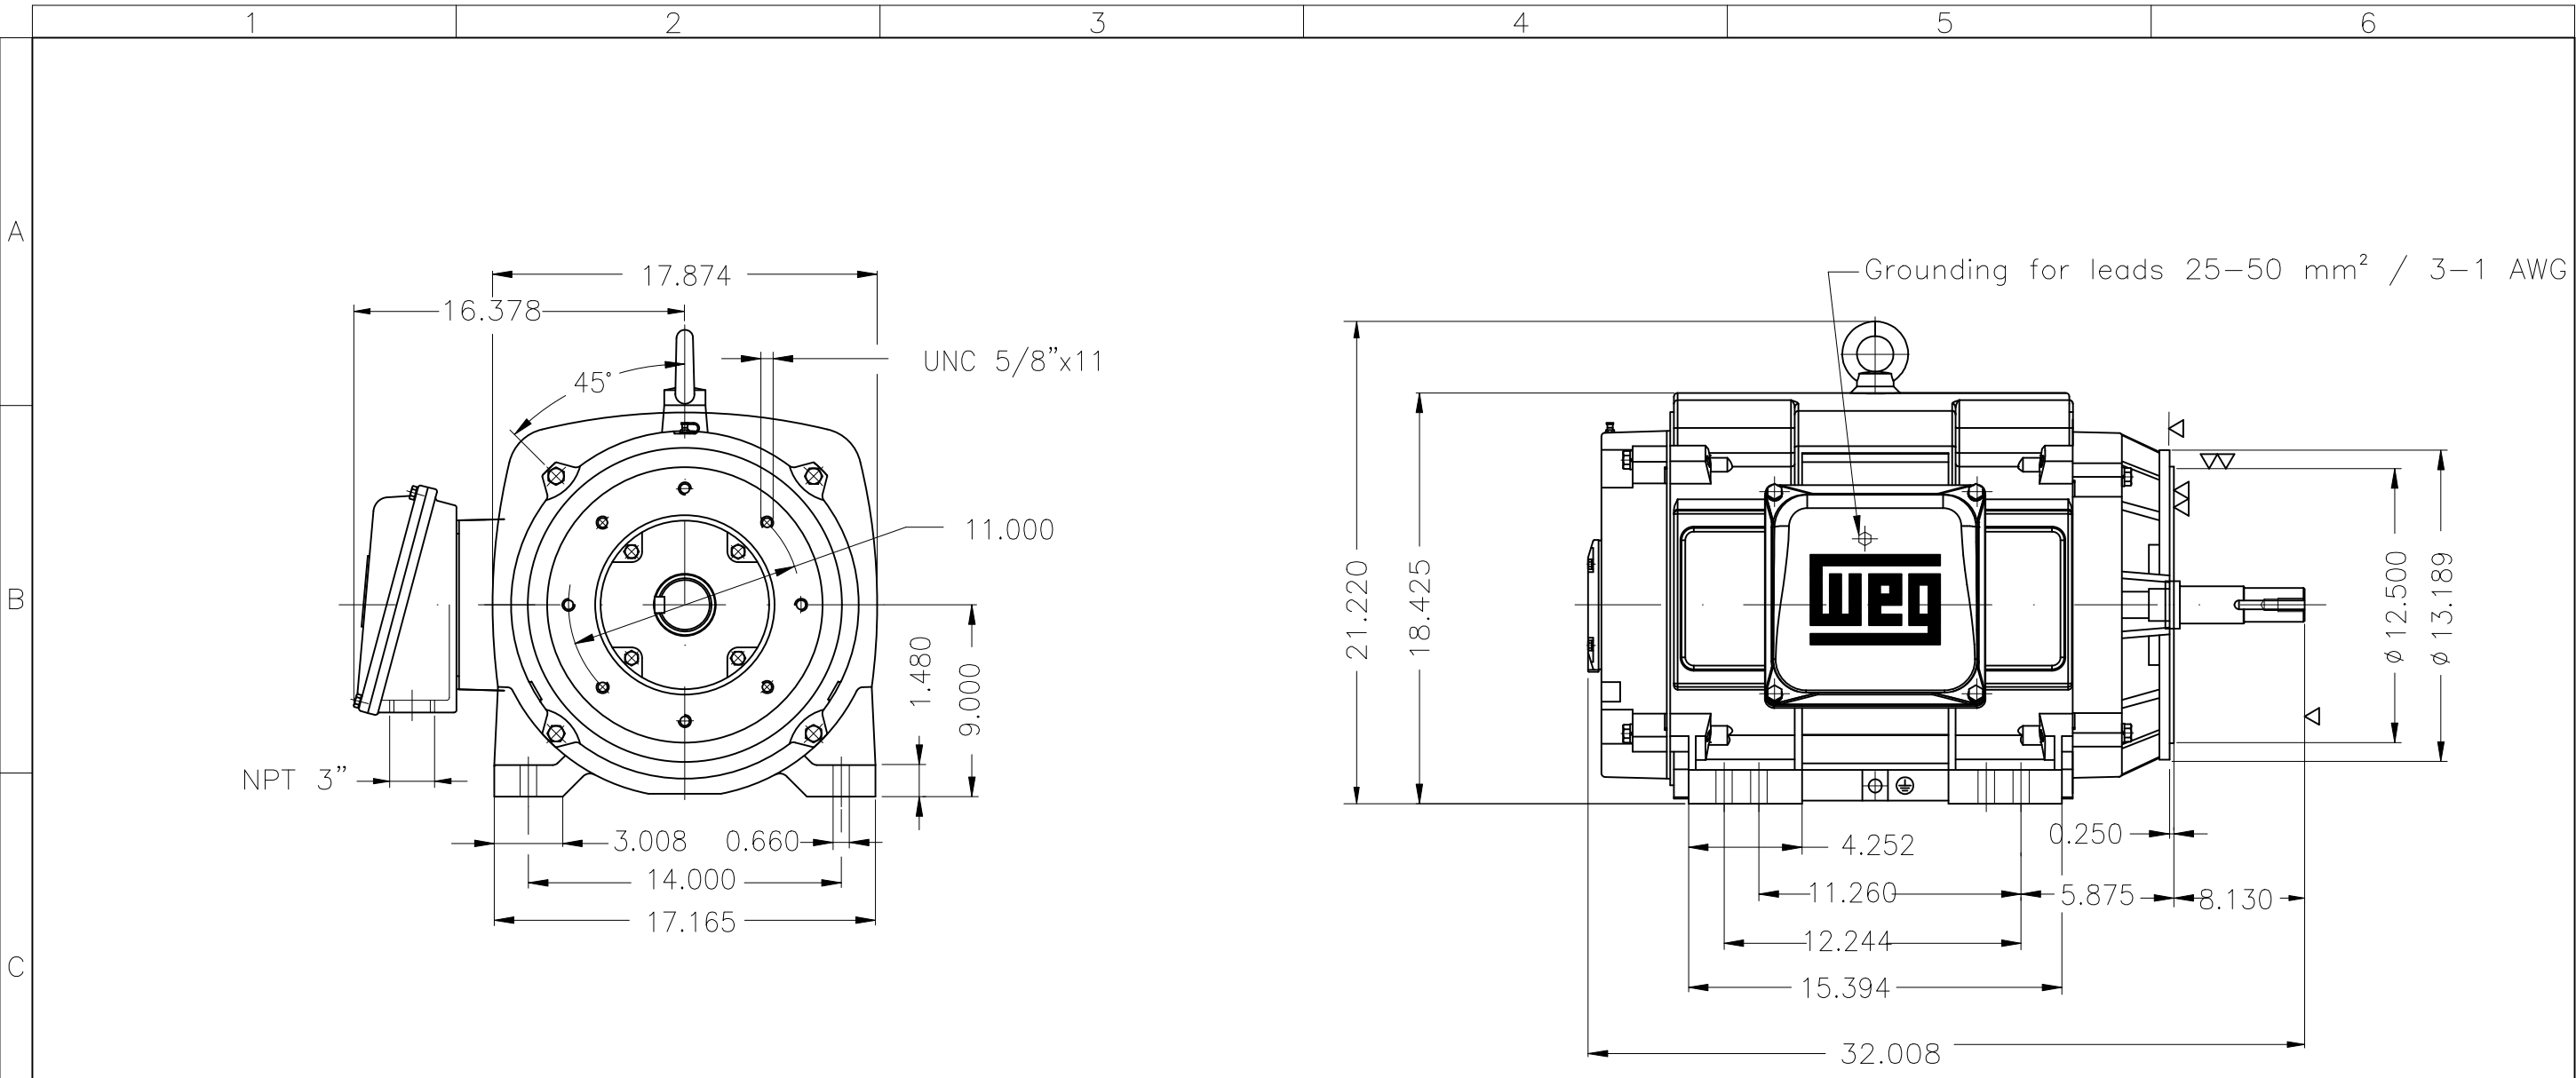

D																			
E					75 HP 04 Poles 60 Hz										A				
Certification UL/FIRE PUMP								HYBRISUSER								00			
Color RAL 5009				ECM		LOC		SUMMARY OF MODIFICATIONS		EXECUTED		CHECKED		RELEASED		DATE		VER	
Painting plan 203A				EXECUTED		HYBRISUSER				THREE PH. MOTOR JM/JP/JET PUMP HIGH EFF. FRAME 364/5JP IP23 ODP		PREVIEW		WDD		00			
Mounting NEMA F-1				CHECKED															
Mounting B34R(D)				RELEASED															
				REL. DATE				WMO		Jaragua do Sul		Product Engineering		SHEET		1 / 1			