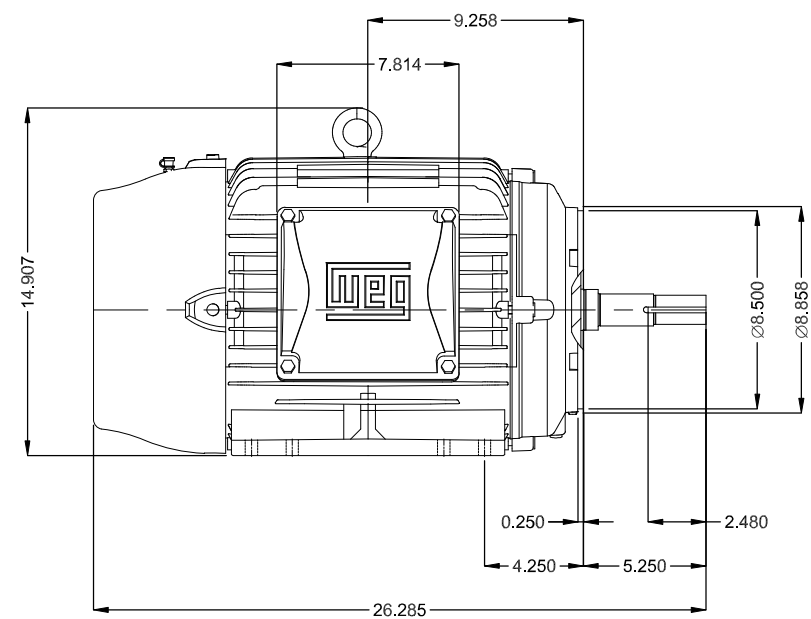
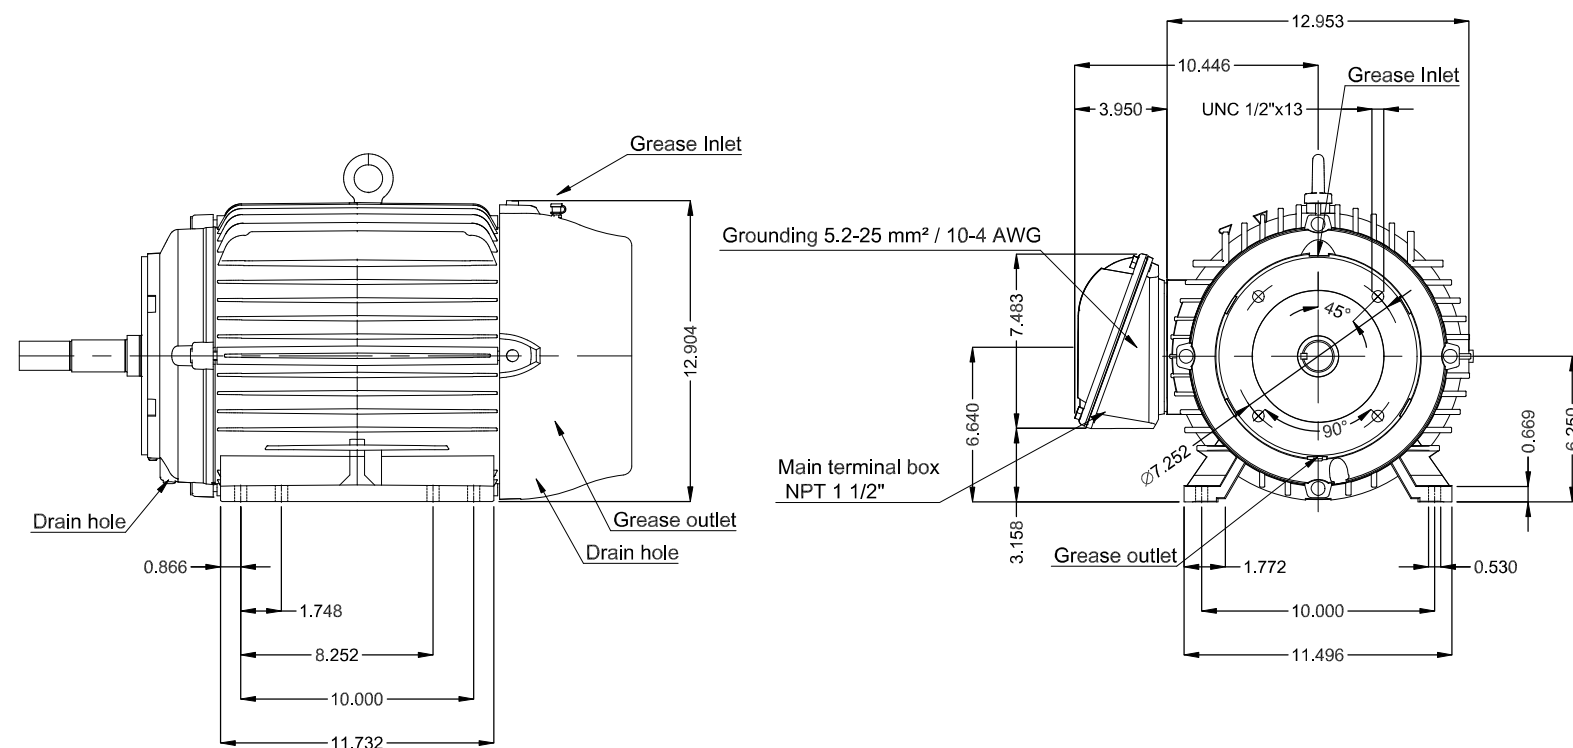


20 HP 02 Poles 60 Hz										A		
						HYBRISUSER				00		
ECM	LOC	SUMMARY OF MODIFICATIONS				EXECUTED	CHECKED	RELEASED	DATE	VER		
EXECUTED	HYBRISUSER	 	THREE PH. MOTOR JM/JP/JET PUMP W22 NEMA PREM. EFF. FRAME 254/6JM IP55 TEFC			PREVIEW						
CHECKED						WDD					00	
RELEASED												
REL. DATE											SHEET /	