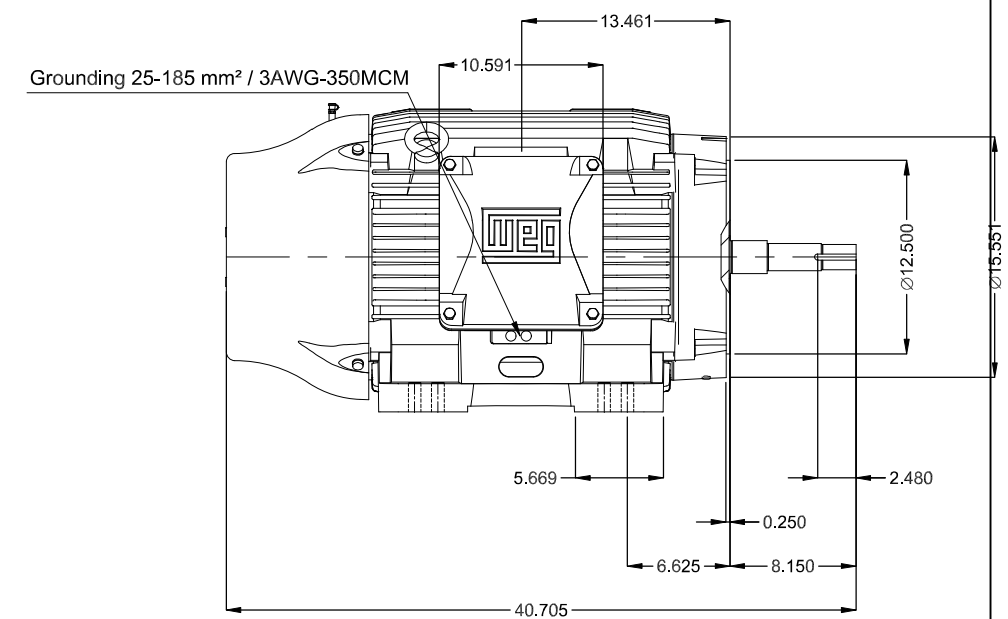
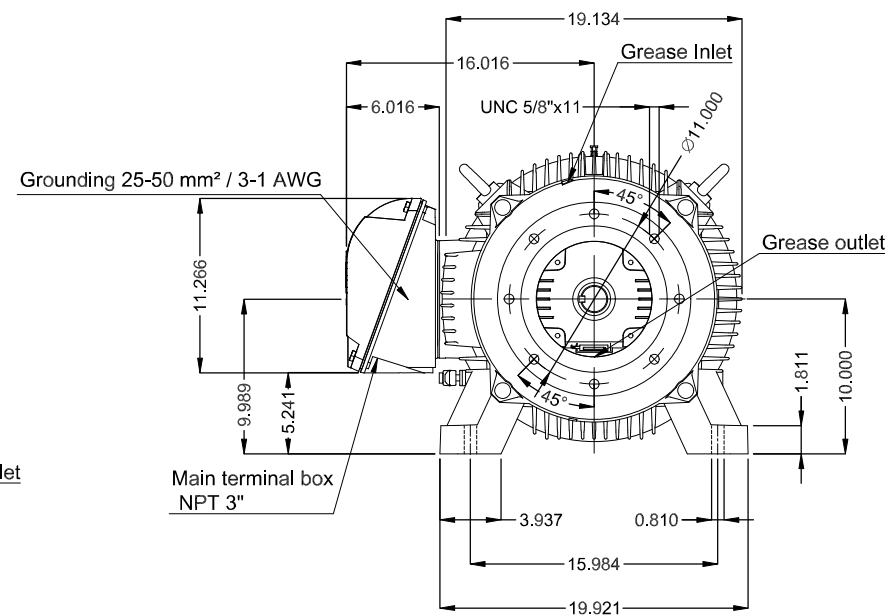
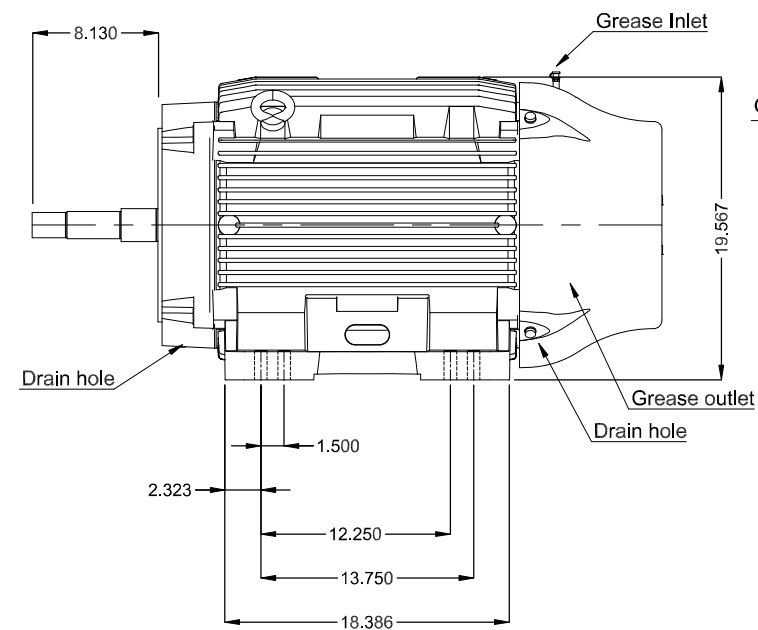


100 HP 02 Poles 60 Hz										A	
							HYBRISUSER				00
ECM	LOC	SUMMARY OF MODIFICATIONS					EXECUTED	CHECKED	RELEASED	DATE	VER
EXECUTED	HYBRISUSER			THREE PH. MOTOR JM/JP/JET PUMP W22 NEMA PREM, EFF. FRAME 404/5JP IP55 TEFC			PREVIEW WDD 00				
CHECKED											
RELEASED											
REL. DATE											
							SHEET		/		