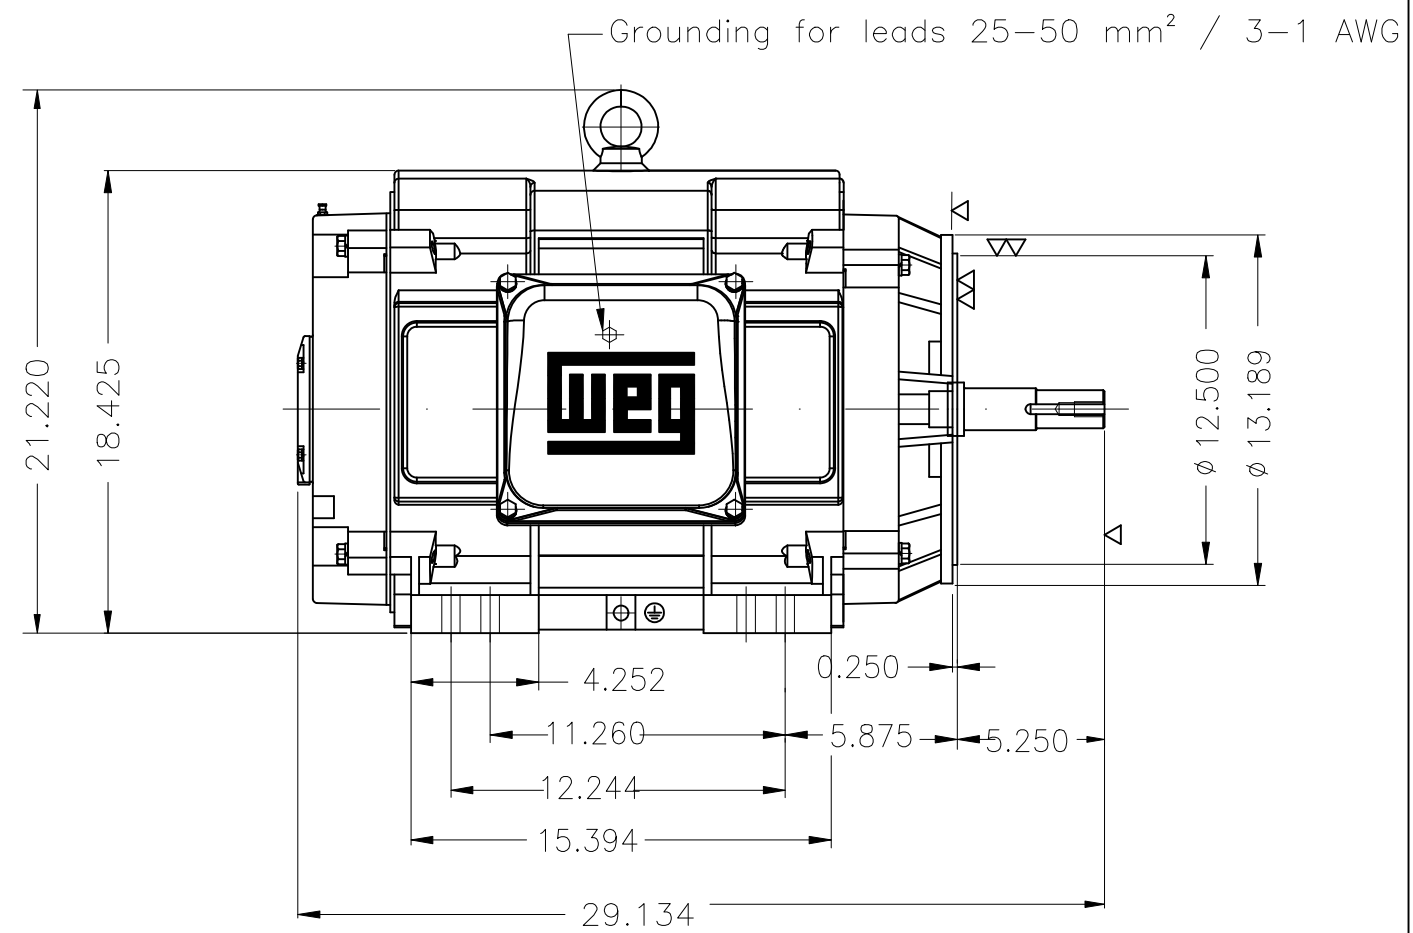
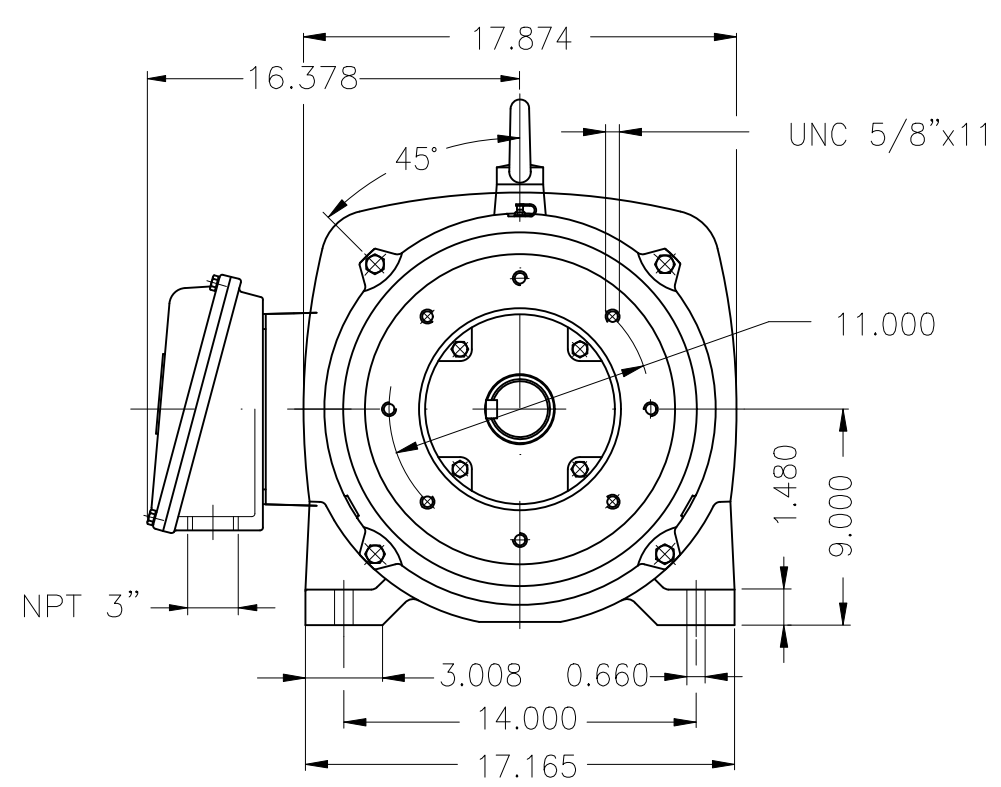



75 HP 04 Poles 60 Hz										A
					HYBRISUSER					00
ECM	LOC	SUMMARY OF MODIFICATIONS			EXECUTED	CHECKED	RELEASED	DATE	VER	
EXECUTED	HYBRISUSER			THREE PH. MOTOR JM/JP/JET PUMP HIGH EFF.			PREVIEW			
CHECKED				FRAME 364/5JM IP23 ODP						
RELEASED										
REL. DATE		WMO	Jaragua do Sul	Product Engineering	SHEET	1 / 1				