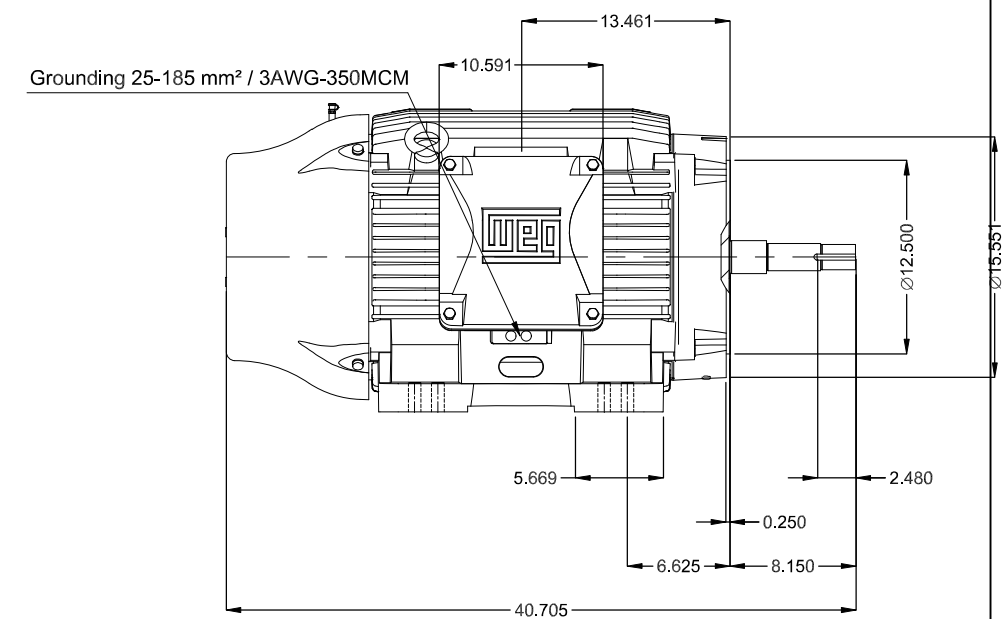
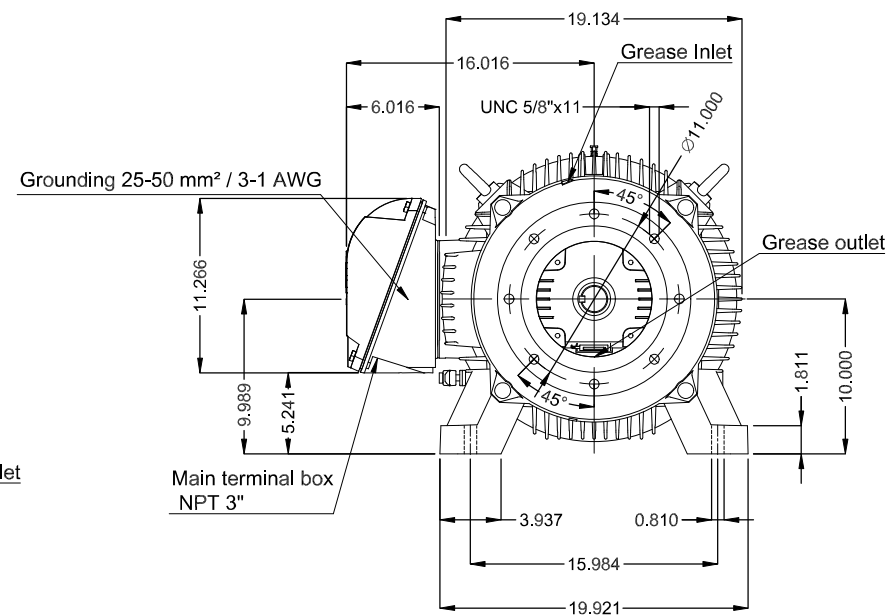
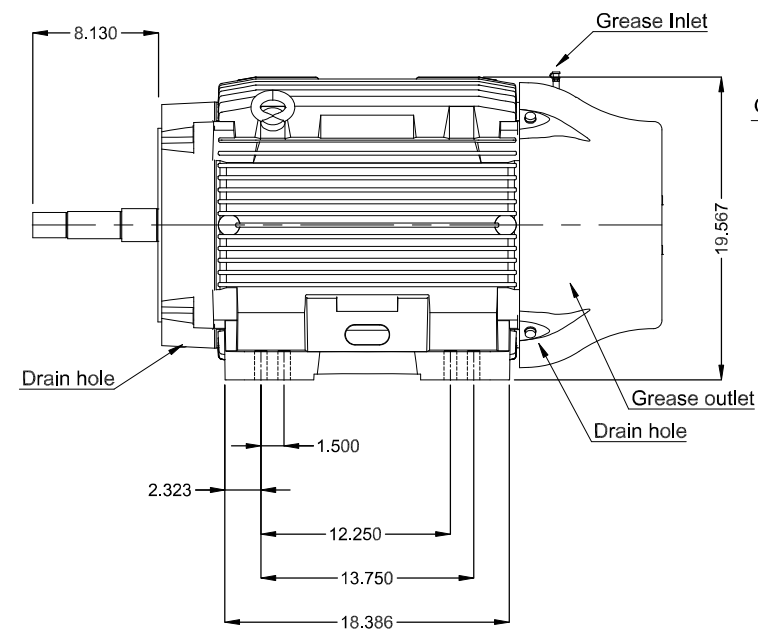


100 HP 04 Poles 60 Hz										A	
							HYBRISUSER			00	
ECM		LOC	SUMMARY OF MODIFICATIONS				EXECUTED	CHECKED	RELEASED	DATE	VER
EXECUTED	HYBRISUSER		THREE PH. MOTOR JM/JP/JET PUMP W22 NEMA PREM. EFF. FRAME 404/5JP IP55 TEFC					PREVIEW WDD 00			
CHECKED											
RELEASED											
REL. DATE											
						SHEET		/			