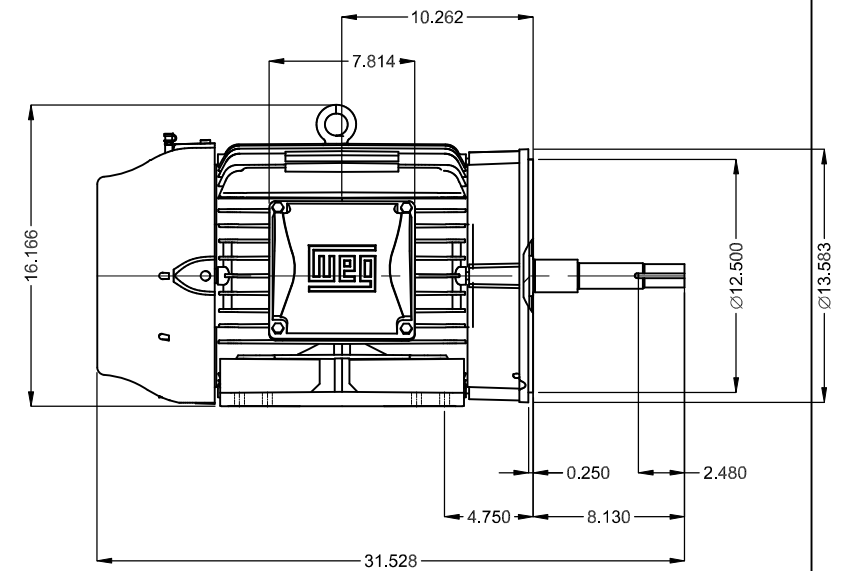


25 HP 02 Poles 60 Hz										A
					HYBRISUSER					
ECM		LOC		SUMMARY OF MODIFICATIONS			EXECUTED		CHECKED	
							RELEASED		DATE	
EXECUTED		HYBRISUSER		 THREE PH. MOTOR JM/JP/JET PUMP W22 NEMA PREM, EFF. FRAME 284/6JP IP55 TEFC			WDD 00 SHEET /			
CHECKED										
RELEASED										
REL. DATE										