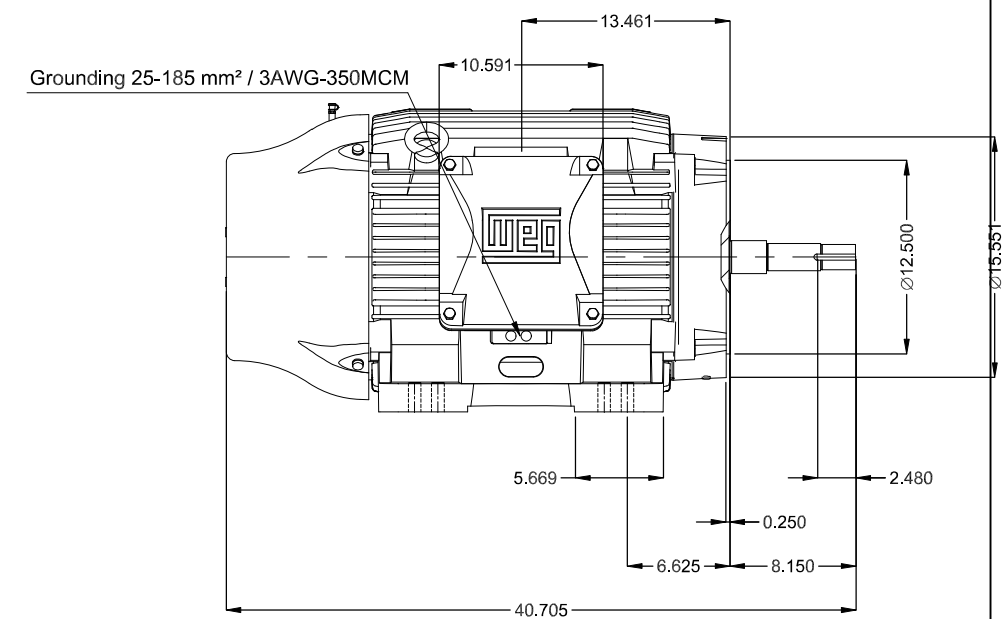
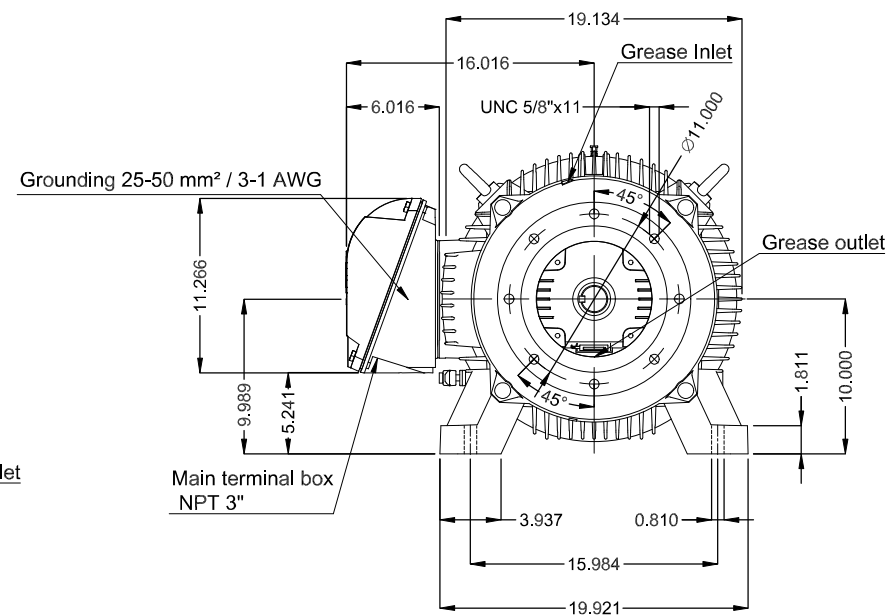
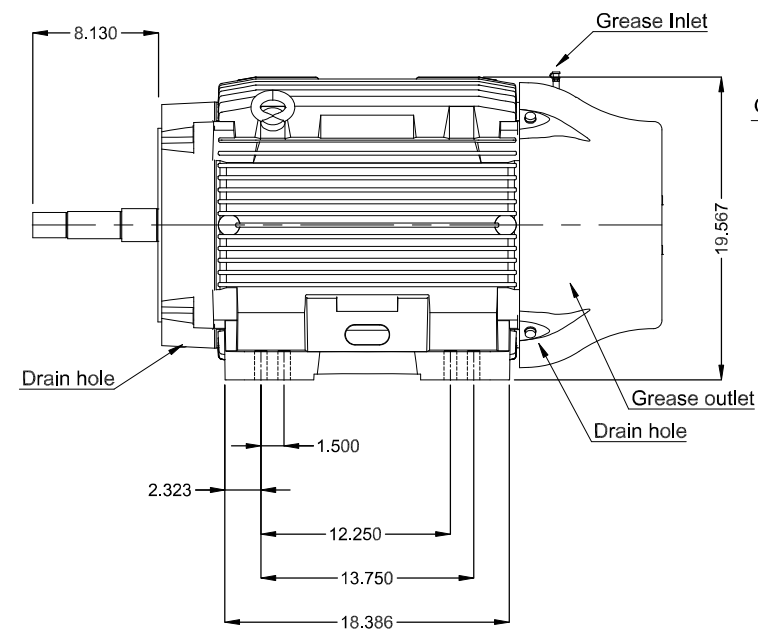


60 HP 06 Poles 60 Hz										A
							HYBRISUSER			
ECM		LOC		SUMMARY OF MODIFICATIONS			EXECUTED		CHECKED	
							RELEASED		DATE	
EXECUTED		HYBRISUSER		 THREE PH. MOTOR JM/JP/JET PUMP W22 NEMA PREM. EFF. FRAME 404/5JP IP55 TEFC			WDD 00			
CHECKED										
RELEASED										
REL. DATE										
							SHEET		/	