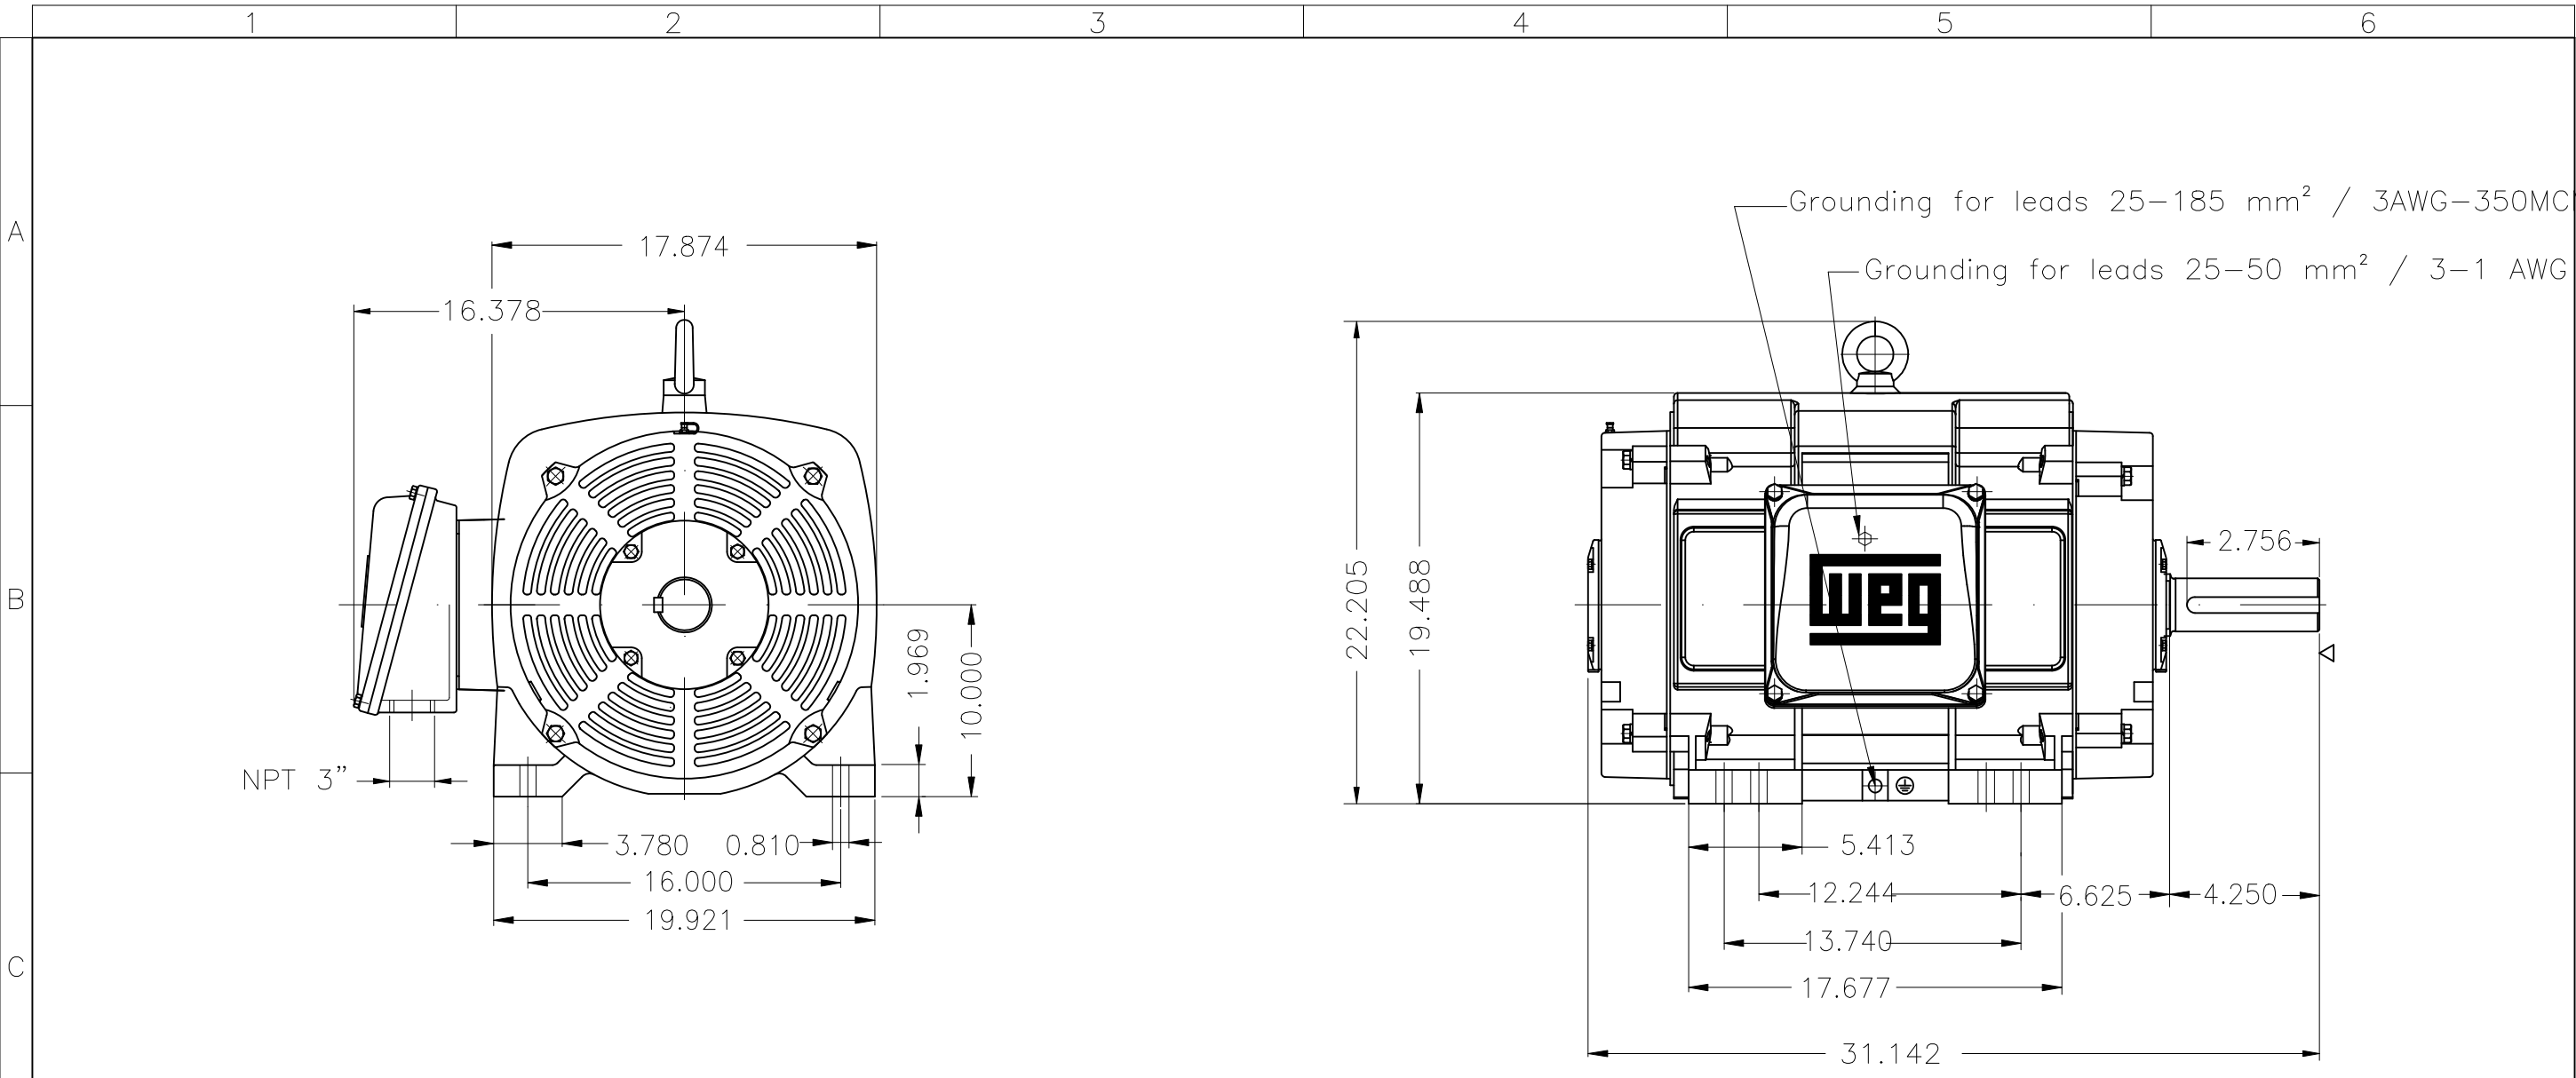


E						125 HP 04 Poles 60 Hz										A	
Certification UL/FIRE PUMP										HYBRISUSER					00		
TS shaft end																	
Color RAL 3002																	
Painting plan 203A																	
Mounting NEMA F-1																	
Mounting B3R(D)																	

ECM	LOC	SUMMARY OF MODIFICATIONS				EXECUTED	CHECKED	RELEASED	DATE	VER
EXECUTED	HYBRISUSER		THREE PH. MOTOR GENERAL HIGH EFF.				PREVIEW			
CHECKED			FRAME 404/5TS IP23 ODP				WDD 00			
RELEASED										
REL. DATE		WMO	Jaragua do Sul				Product Engineering		SHEET 1 / 1	