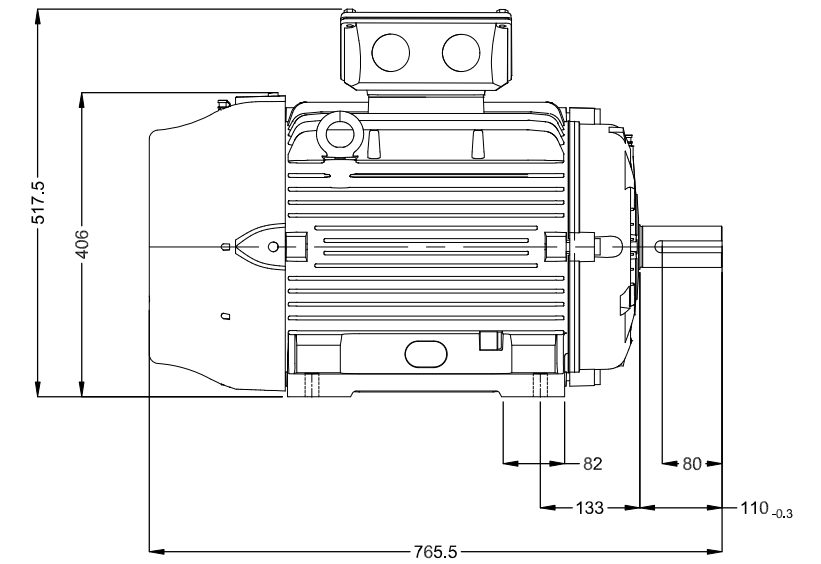
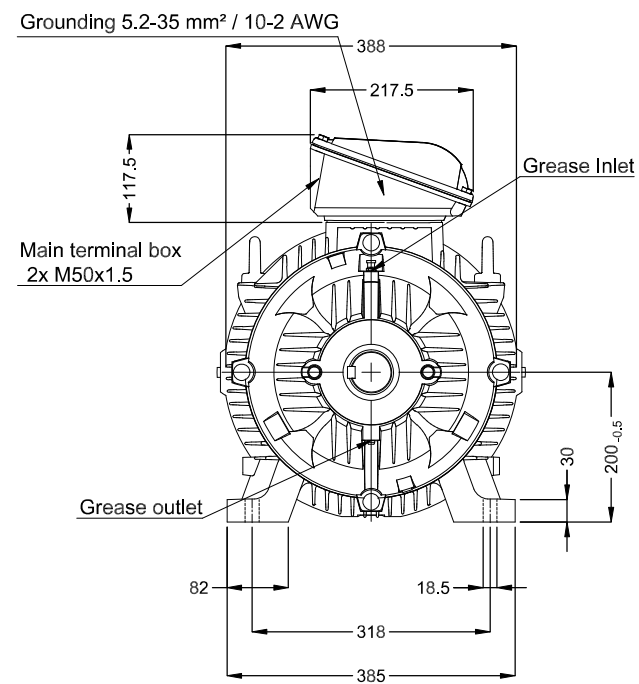
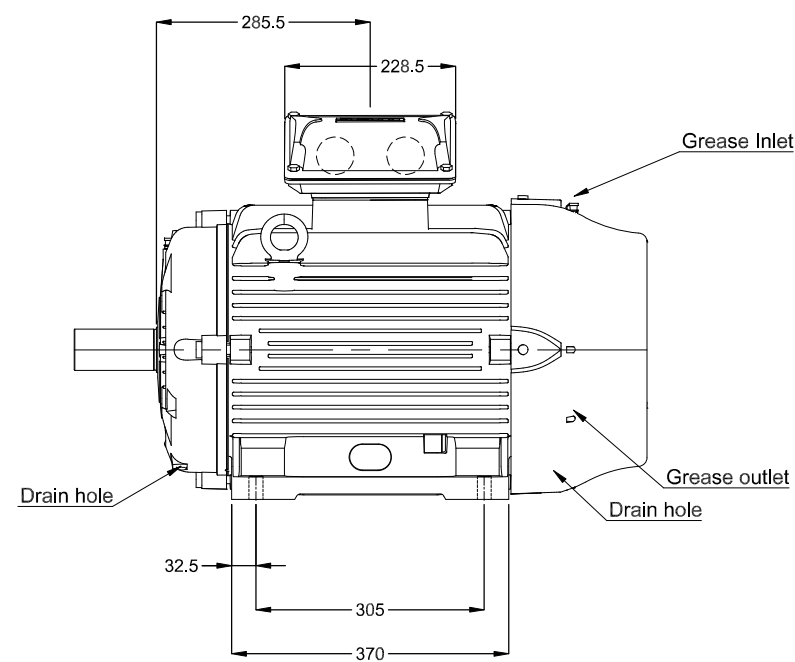



30 HP 06 Poles 60 Hz										A
				HYBRISUSER					00	
ECM		LOC		SUMMARY OF MODIFICATIONS			EXECUTED		CHECKED	
							RELEASED		DATE	
							VER			
EXECUTED		HYBRISUSER		 THREE PH. MOTOR W22 IE3 FRAME 200L IP55 TEFC			PREVIEW WDD 00			
CHECKED										
RELEASED										
REL. DATE										
							SHEET		/	