


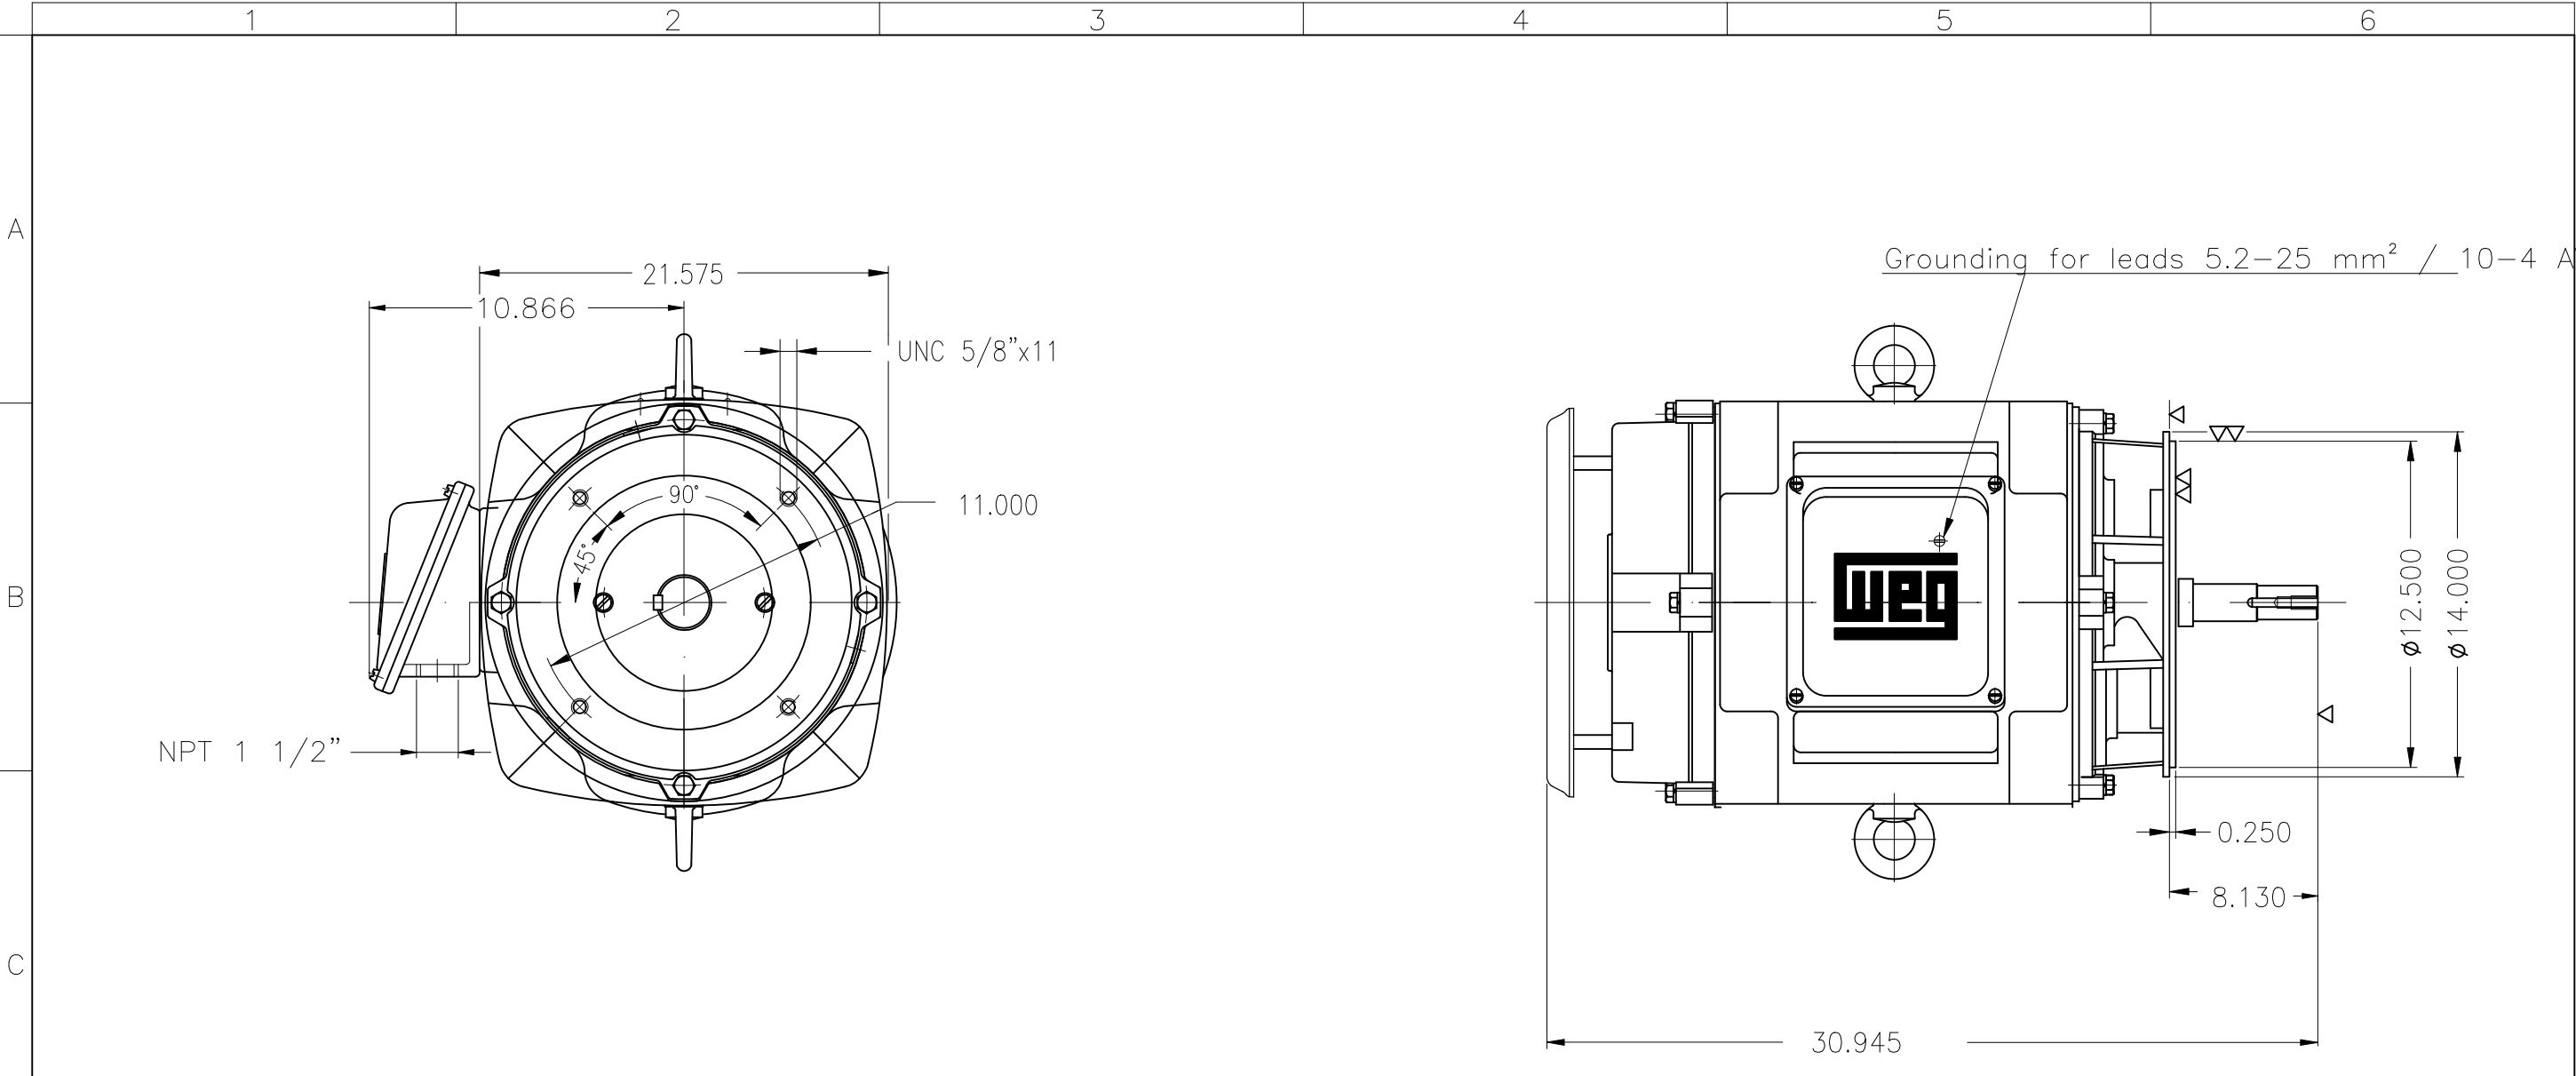

D																					
E					40 HP 02 Poles 60 Hz		A														
Certification UL/FIRE PUMP				ECM		LOC		SUMMARY OF MODIFICATIONS		EXECUTED		CHECKED		RELEASED		DATE		VER			
Color RAL 3002								THREE PH. MOTOR JM/JP/JET PUMP HIGH EFF.				PREVIEW		WDD		00					
Painting plan 203A								FRAME 286JP IP23 ODP													
Mounting NEMA W-6																					
Mounting V18								REL. DATE				WMO		Jaragua do Sul		Product Engineering		SHEET		1 / 1	