


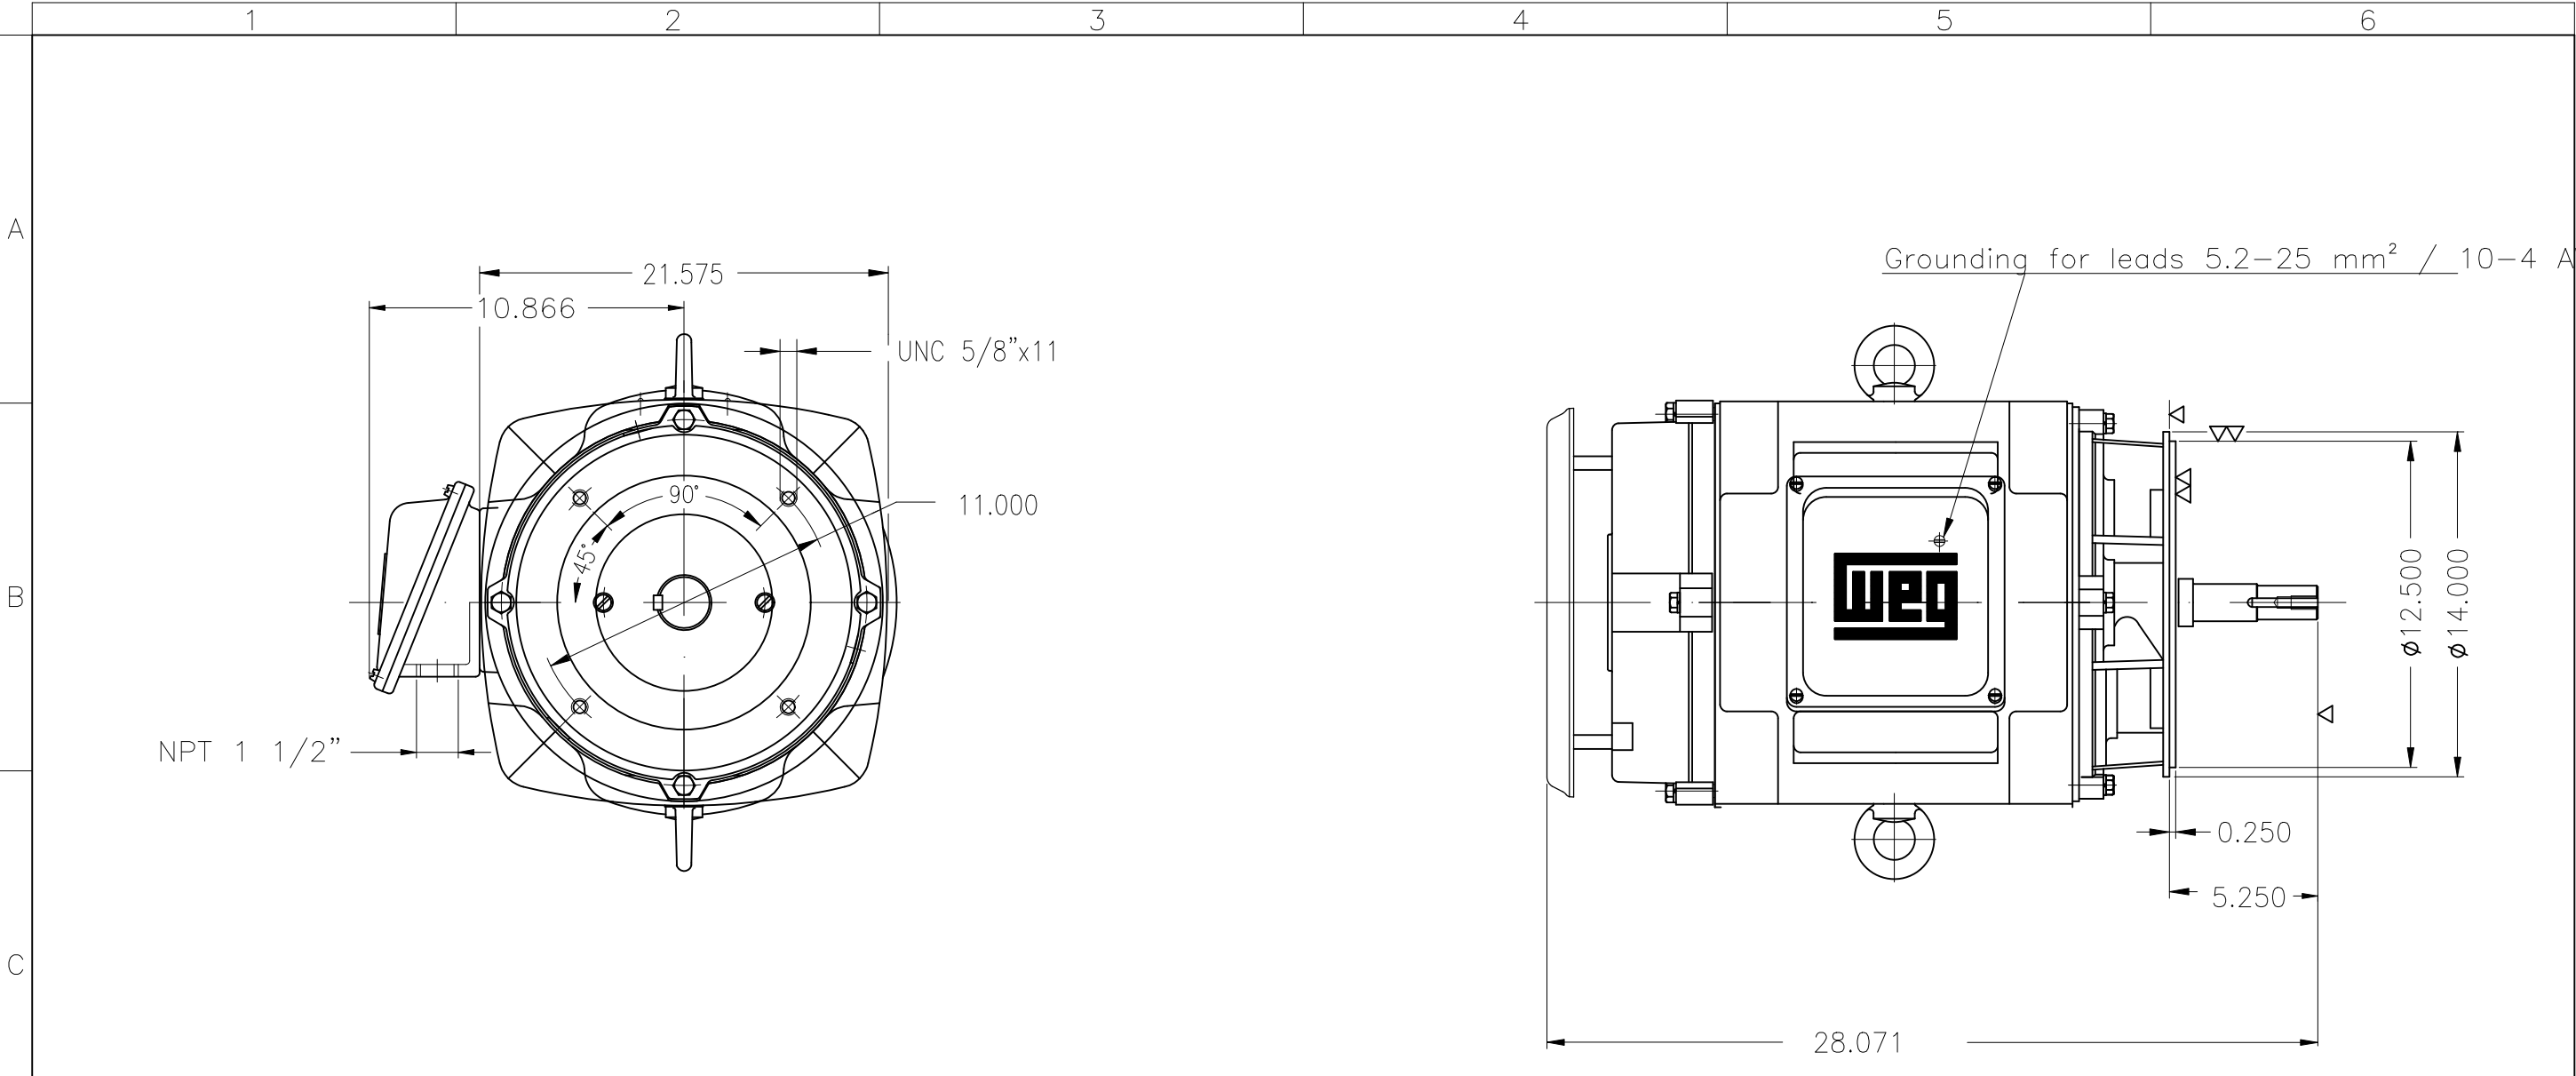

D													
			40 HP 02 Poles 60 Hz										
E								HYBRISUSER					00
			ECM	LOC	SUMMARY OF MODIFICATIONS			EXECUTED	CHECKED	RELEASED	DATE	VER	
			EXECUTED	HYBRISUSER		THREE PH. MOTOR JM/JP/JET PUMP HIGH EFF. FRAME 286JM IP23 ODP			PREVIEW WDD 00				
			CHECKED										
			RELEASED										
REL. DATE		WMO	Jaragua do Sul	Product Engineering	SHEET	1 / 1							