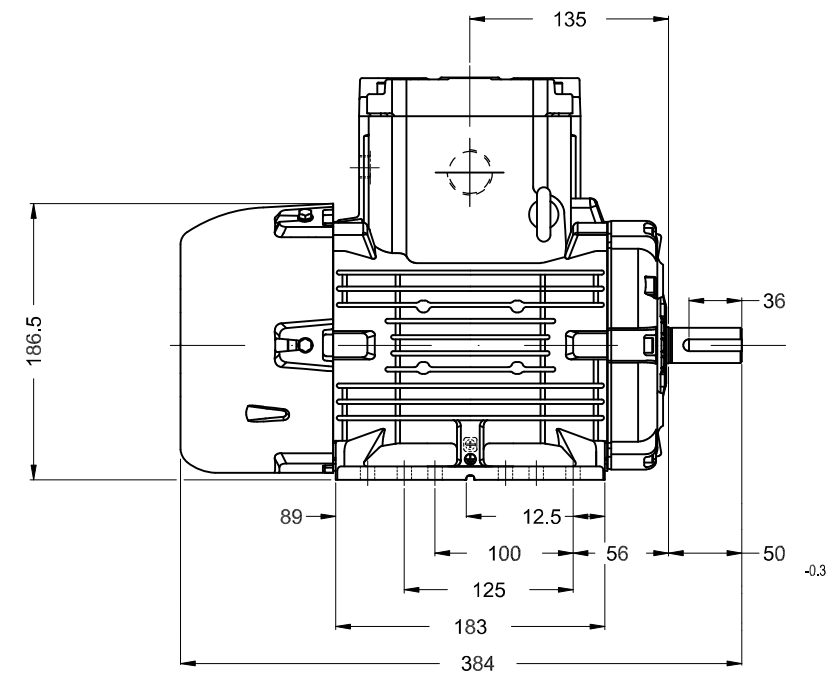
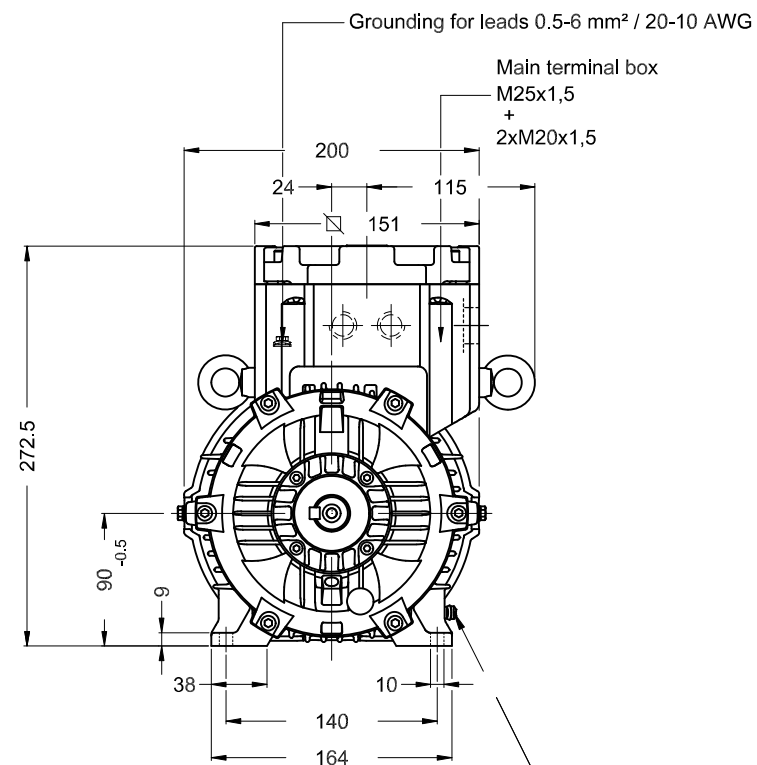


1.5 kW 02 Poles 50 Hz										A	
							HYBRISUSER			00	
ECM	LOC	SUMMARY OF MODIFICATIONS					EXECUTED	CHECKED	RELEASED	DATE	VER
EXECUTED	HYBRISUSER		THREE PH. MOTOR W22Xdb IE3 FRAME 90S/L IP56 TEFC				PREVIEW WDD 00				
CHECKED											
RELEASED											
REL. DATE		WMO	Jaragua do Sul	Product Engineering	SHEET	1 / 1					