


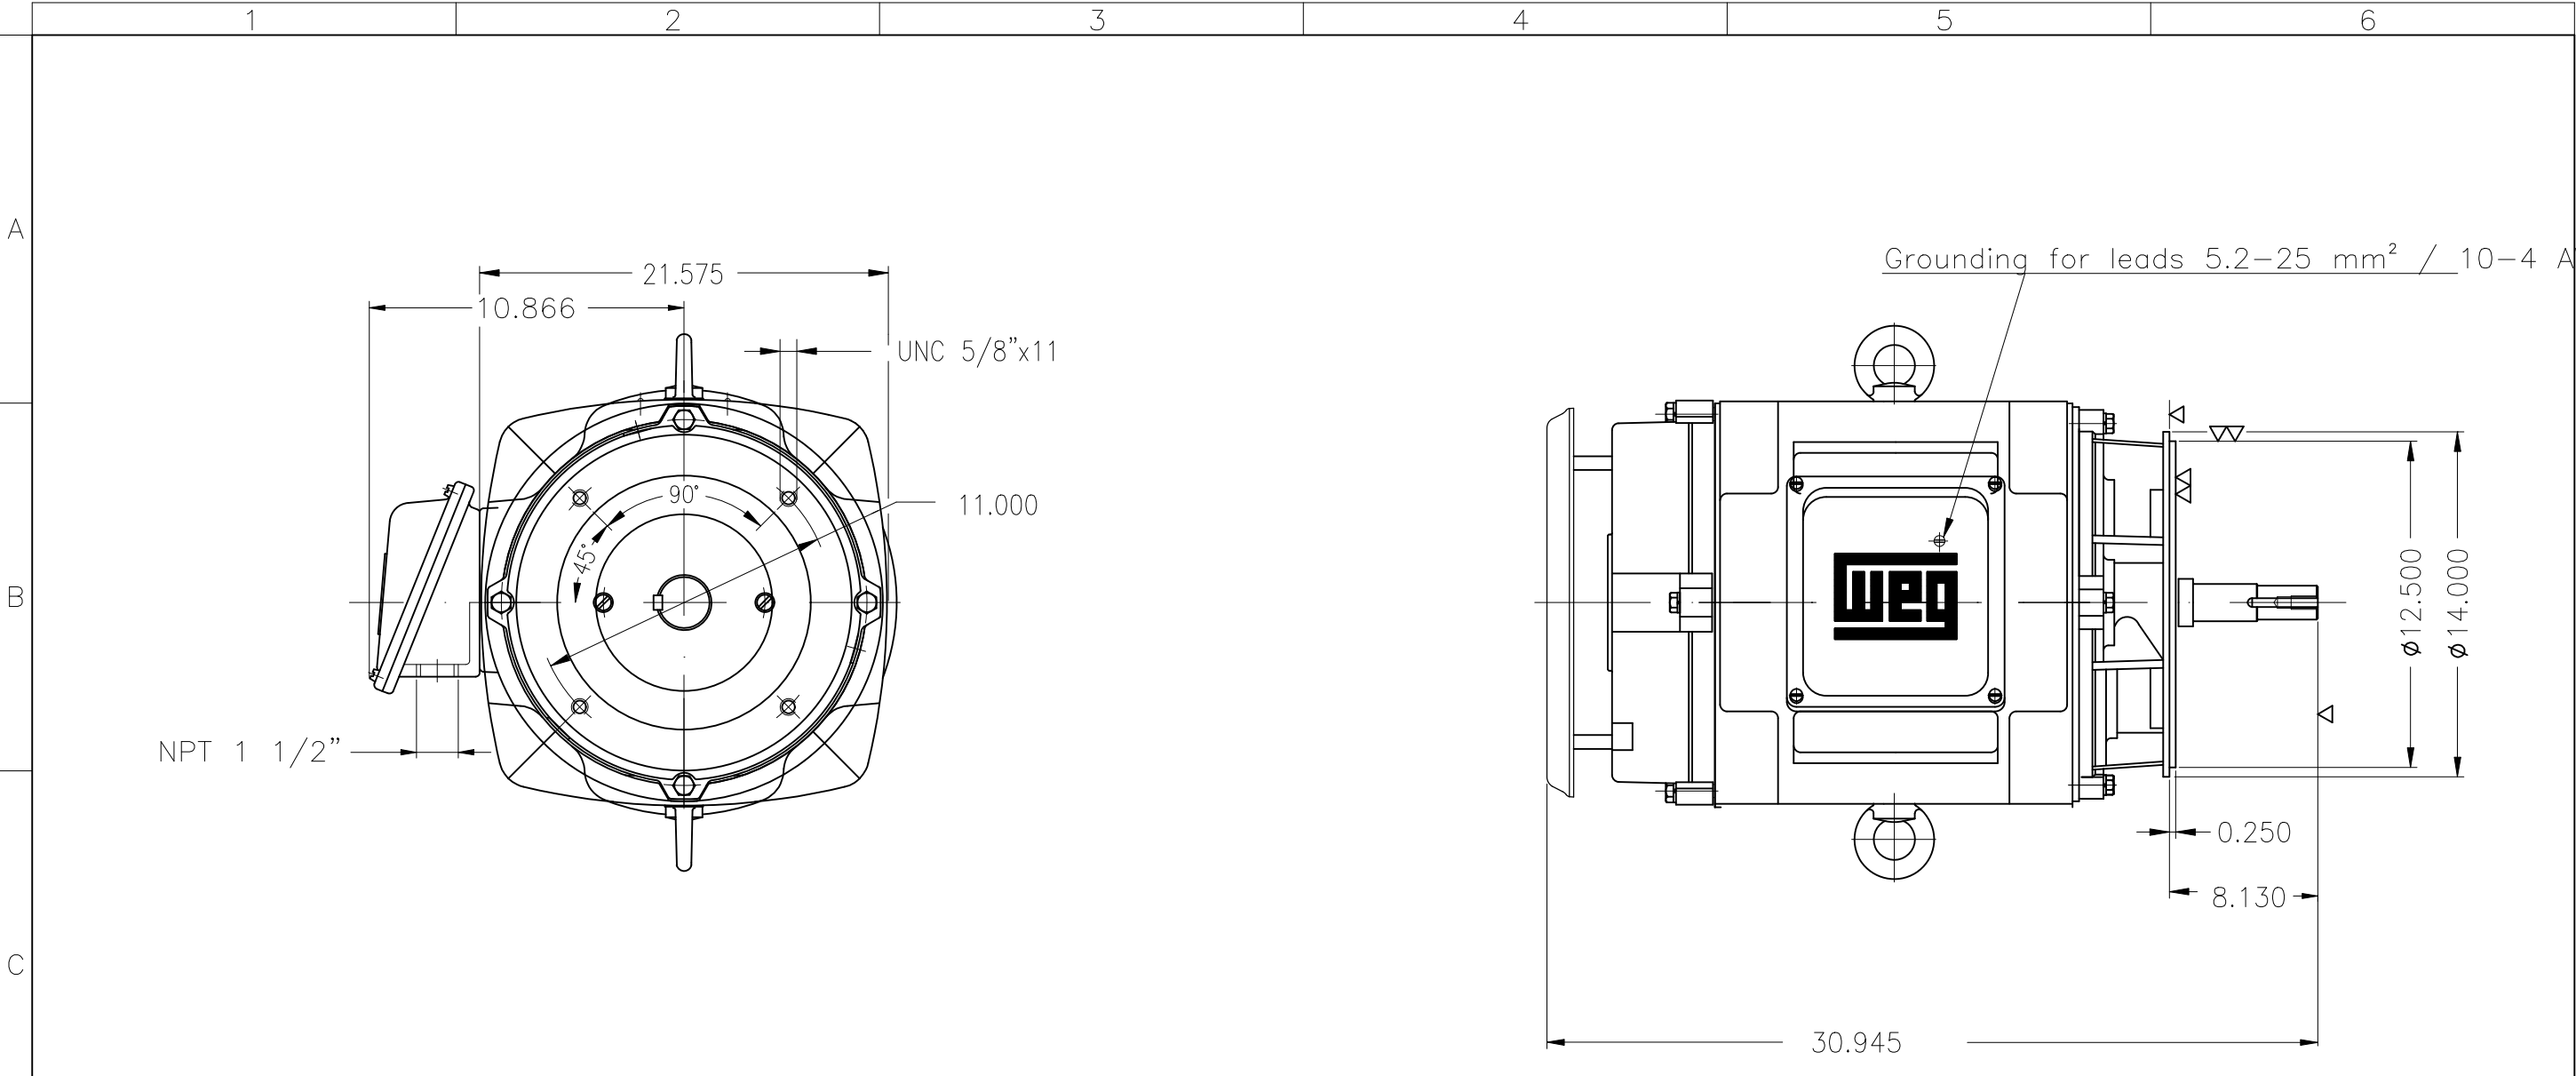

Certification UL/FIRE PUMP Color RAL 3002 Painting plan 203A Mounting NEMA W-6 Mounting V18			40 HP 02 Poles 60 Hz										A	
									HYBRISUSER					00
			ECM	LOC	SUMMARY OF MODIFICATIONS				EXECUTED	CHECKED	RELEASED	DATE	VER	
EXECUTED	HYBRISUSER		THREE PH. MOTOR JM/JP/JET PUMP HIGH EFF.				PREVIEW							
CHECKED			FRAME 286JP IP23 ODP											
RELEASED														
REL. DATE		WMO	Jaragua do Sul				Product Engineering	SHEET	1 / 1					