


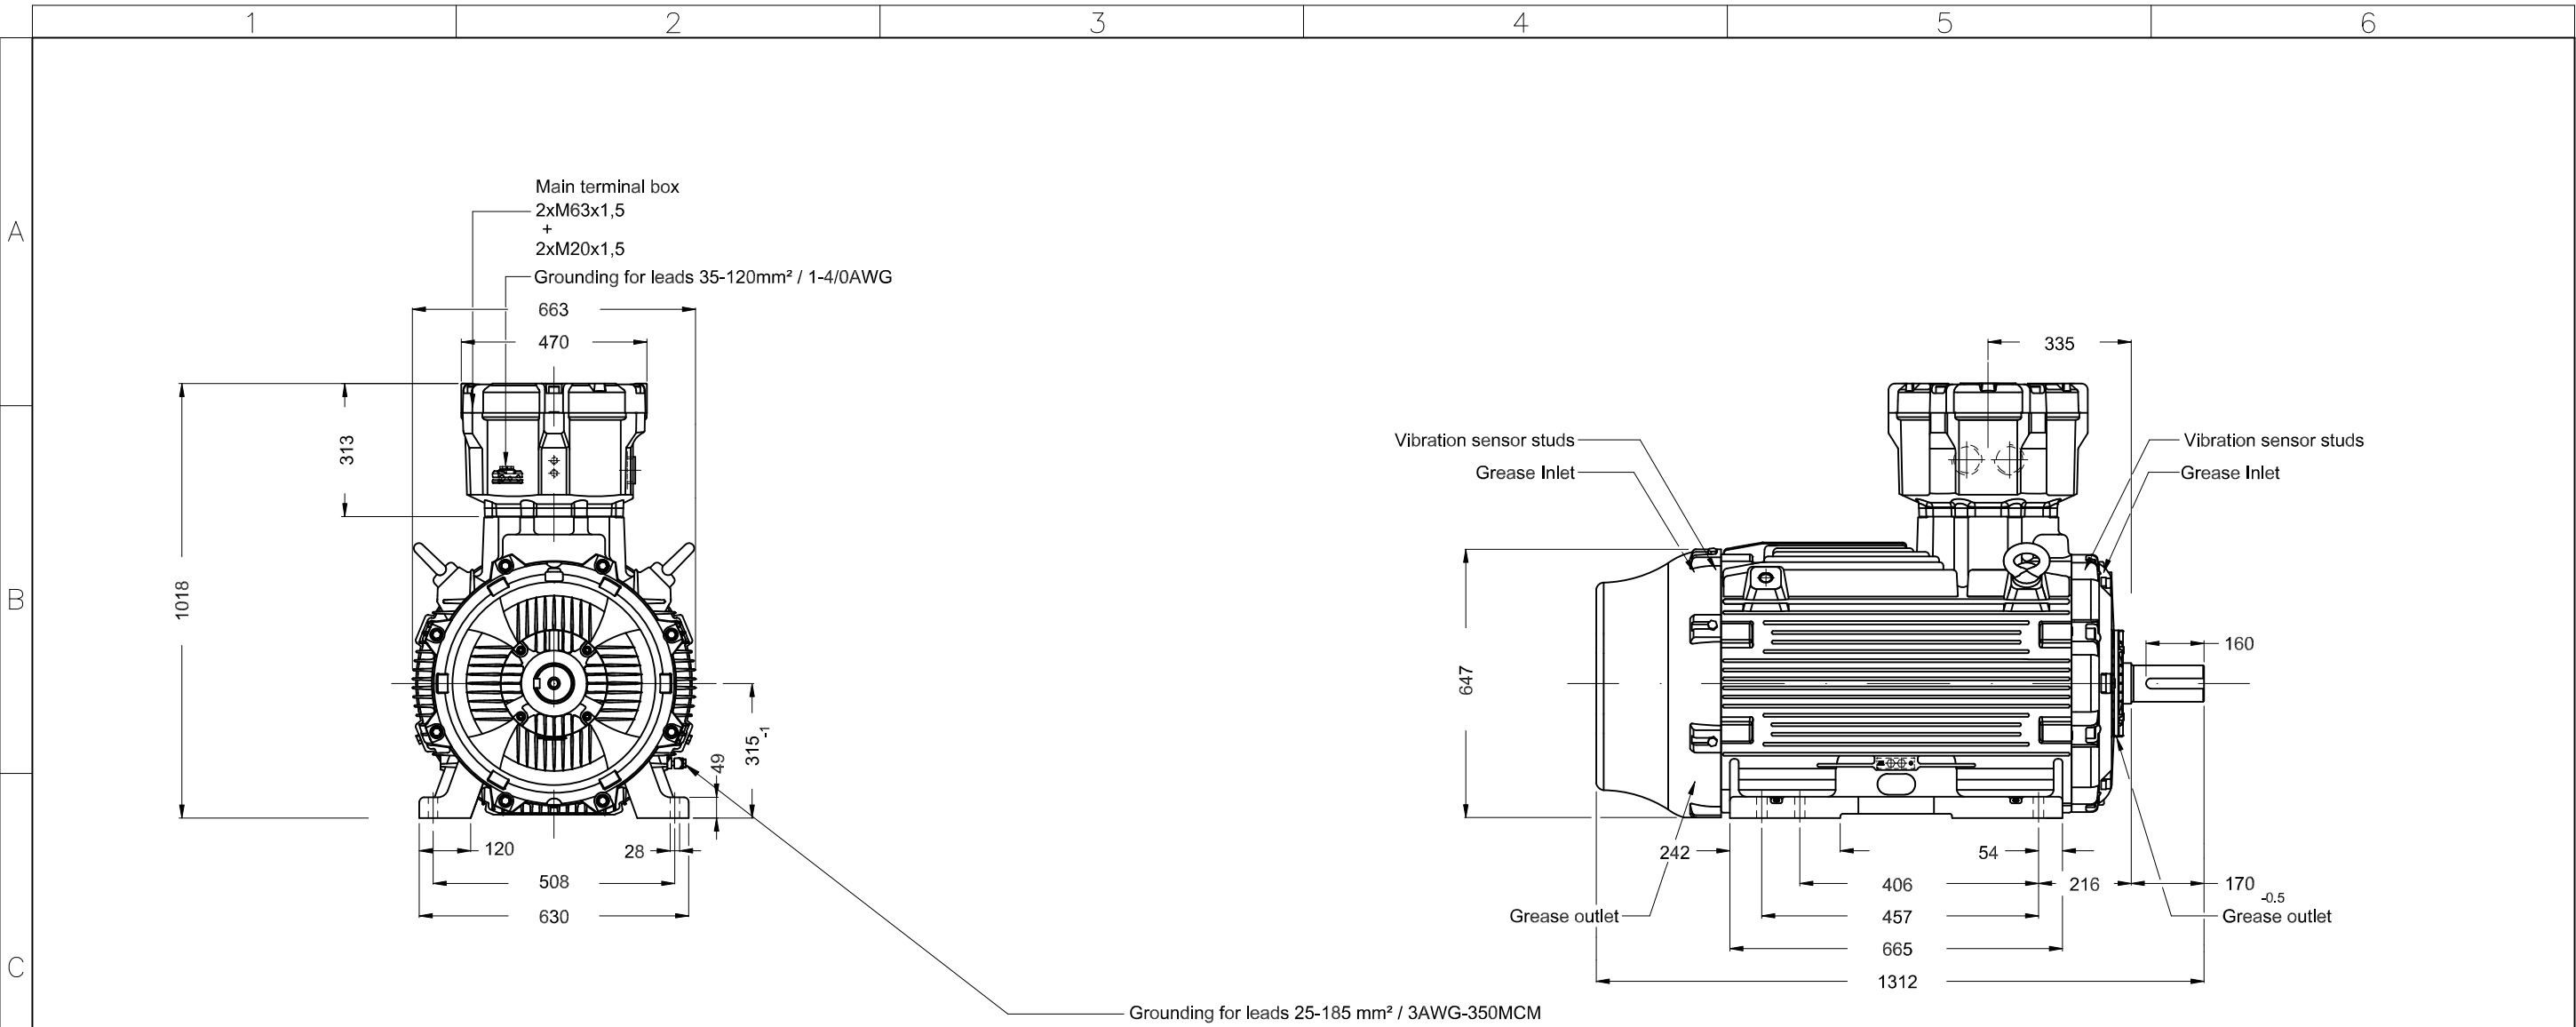

|   |                       |  |  |  |  |  |  |  |  |  |   |
|---|-----------------------|--|--|--|--|--|--|--|--|--|---|
| E | 160 kW 04 Poles 50 Hz |  |  |  |  |  |  |  |  |  | A |
|   |                       |  |  |  |  |  |  |  |  |  |   |
|   |                       |  |  |  |  |  |  |  |  |  |   |
|   |                       |  |  |  |  |  |  |  |  |  |   |
| D |                       |  |  |  |  |  |  |  |  |  |   |
|   |                       |  |  |  |  |  |  |  |  |  |   |
|   |                       |  |  |  |  |  |  |  |  |  |   |
|   |                       |  |  |  |  |  |  |  |  |  |   |
|   |                       |  |  |  |  |  |  |  |  |  |   |
| C |                       |  |  |  |  |  |  |  |  |  |   |
|   |                       |  |  |  |  |  |  |  |  |  |   |
|   |                       |  |  |  |  |  |  |  |  |  |   |
|   |                       |  |  |  |  |  |  |  |  |  |   |
|   |                       |  |  |  |  |  |  |  |  |  |   |
| B |                       |  |  |  |  |  |  |  |  |  |   |
|   |                       |  |  |  |  |  |  |  |  |  |   |
|   |                       |  |  |  |  |  |  |  |  |  |   |
|   |                       |  |  |  |  |  |  |  |  |  |   |
|   |                       |  |  |  |  |  |  |  |  |  |   |
| A |                       |  |  |  |  |  |  |  |  |  |   |
|   |                       |  |  |  |  |  |  |  |  |  |   |
|   |                       |  |  |  |  |  |  |  |  |  |   |
|   |                       |  |  |  |  |  |  |  |  |  |   |
|   |                       |  |  |  |  |  |  |  |  |  |   |

SPM studs

Color RAL 5009

Painting plan 205P

Mounting B3T

DE Shaft End

DM20 WEG WPR-7339 (DS DIN332)

Vibration sensor studs detail

|           |            |                            |  |  |  |                     |         |          |      |     |
|-----------|------------|----------------------------|--|--|--|---------------------|---------|----------|------|-----|
| ECM       | LOC        | SUMMARY OF MODIFICATIONS   |  |  |  | HYBRISUSER          | CHECKED | RELEASED | DATE | VER |
| EXECUTED  | HYBRISUSER | THREE PH. MOTOR W22Xdb IE2 |  |  |  | PREVIEW             |         |          |      |     |
| CHECKED   |            | FRAME 315S/M IP56 TEFC     |  |  |  | WDD 00              |         |          |      |     |
| RELEASED  |            |                            |  |  |  | SHEET 1 / 1         |         |          |      |     |
| REL. DATE |            | WMO Jaragua do Sul         |  |  |  | Product Engineering |         |          |      |     |