
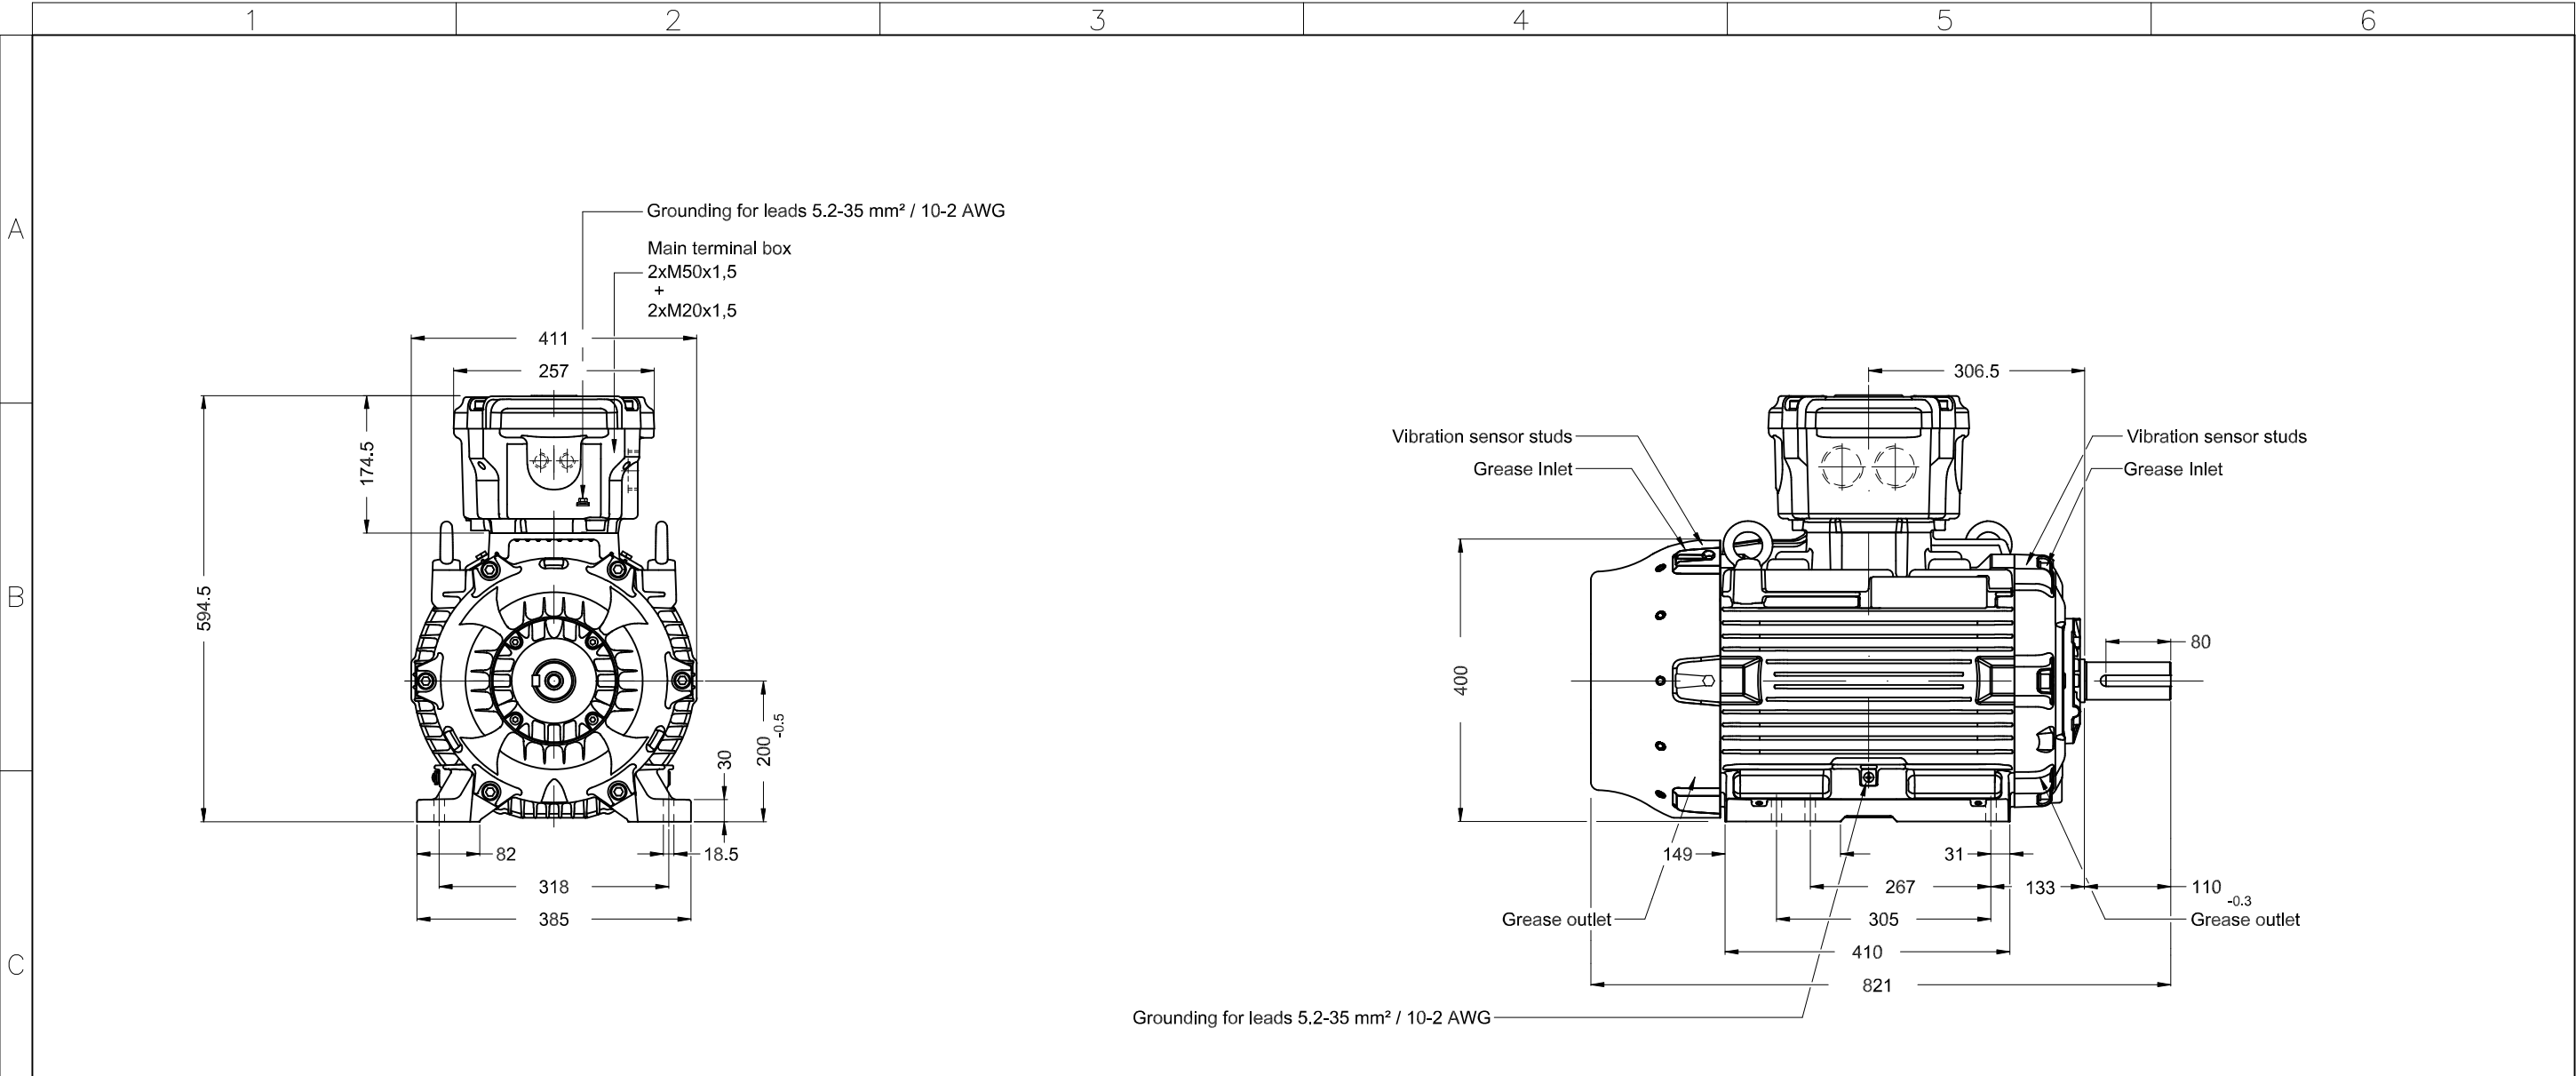






D																	
E																	
SPM studs		DE Shaft End 		Vibration sensor studs detail 		30 kW 04 Poles 50 Hz		A									
						HYBRISUSER						00					
ECM		LOC		SUMMARY OF MODIFICATIONS				EXECUTED		CHECKED		RELEASED		DATE		VER	
EXECUTED		HYBRISUSER				THREE PH. MOTOR W22Xdb IE3 FRAME 200M/L IP56 TEFC				PREVIEW WDD00							
CHECKED																	
RELEASED																	
REL. DATE				WMO		Jaragua do Sul				Product Engineering		SHEET		1 / 1			