


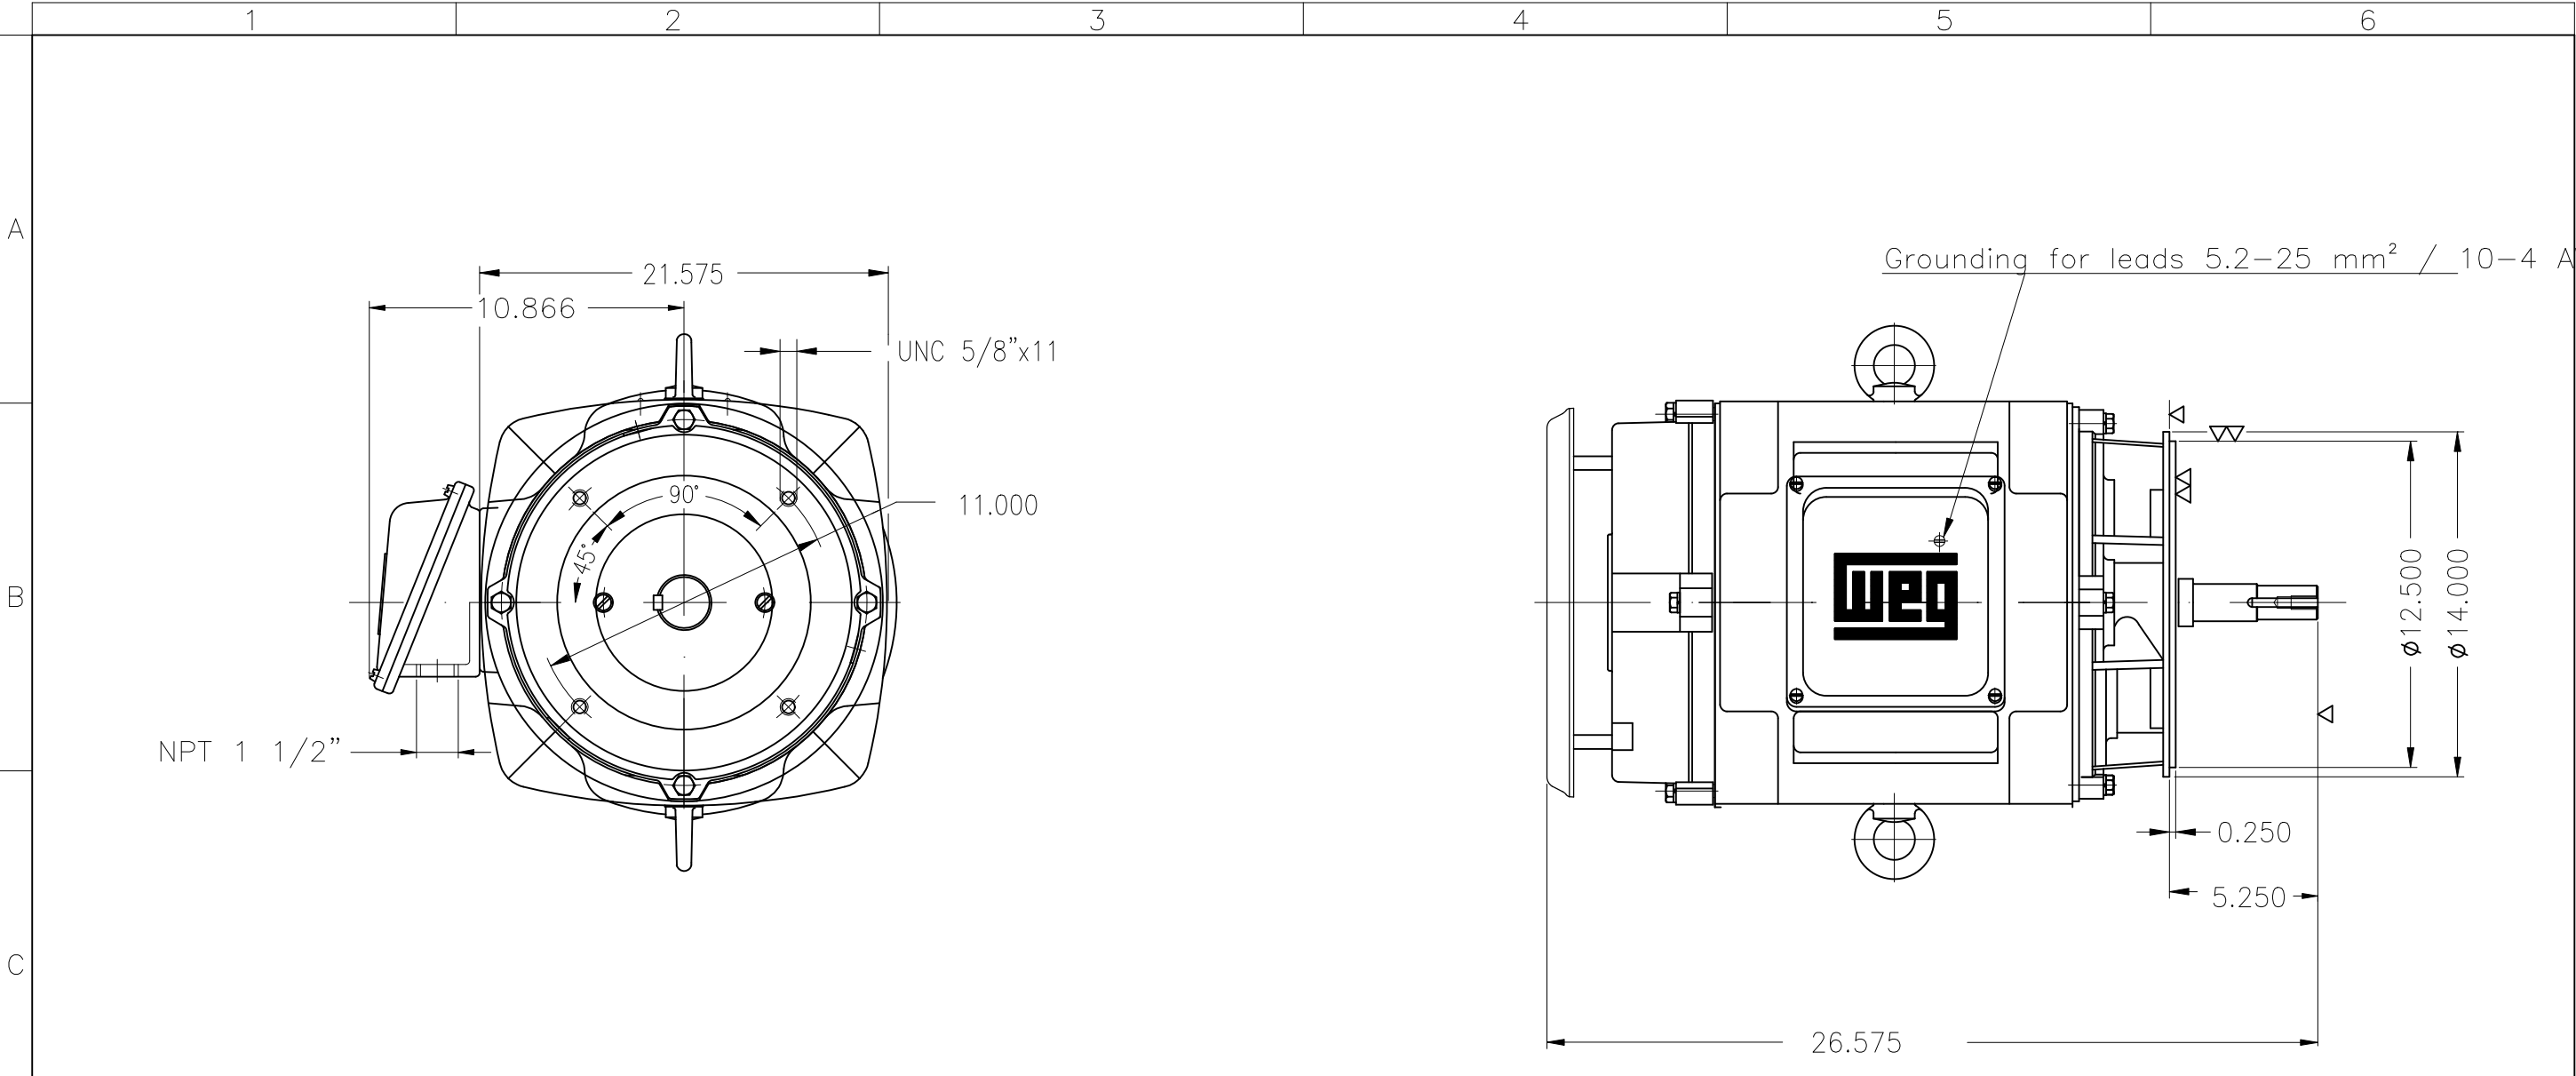

Certification UL/FIRE PUMP Color RAL 3002 Painting plan 203A Mounting NEMA W-6 Mounting V18		30 HP 02 Poles 60 Hz										A	
						HYBRISUSER							00
ECM		LOC	SUMMARY OF MODIFICATIONS				EXECUTED	CHECKED	RELEASED	DATE	VER		
EXECUTED		HYBRISUSER			THREE PH. MOTOR JM/JP/JET PUMP HIGH EFF. FRAME 284JM IP23 ODP				PREVIEW WDD 00				
CHECKED													
RELEASED													
REL. DATE			WMO		Jaragua do Sul		Product Engineering		SHEET		1 / 1		