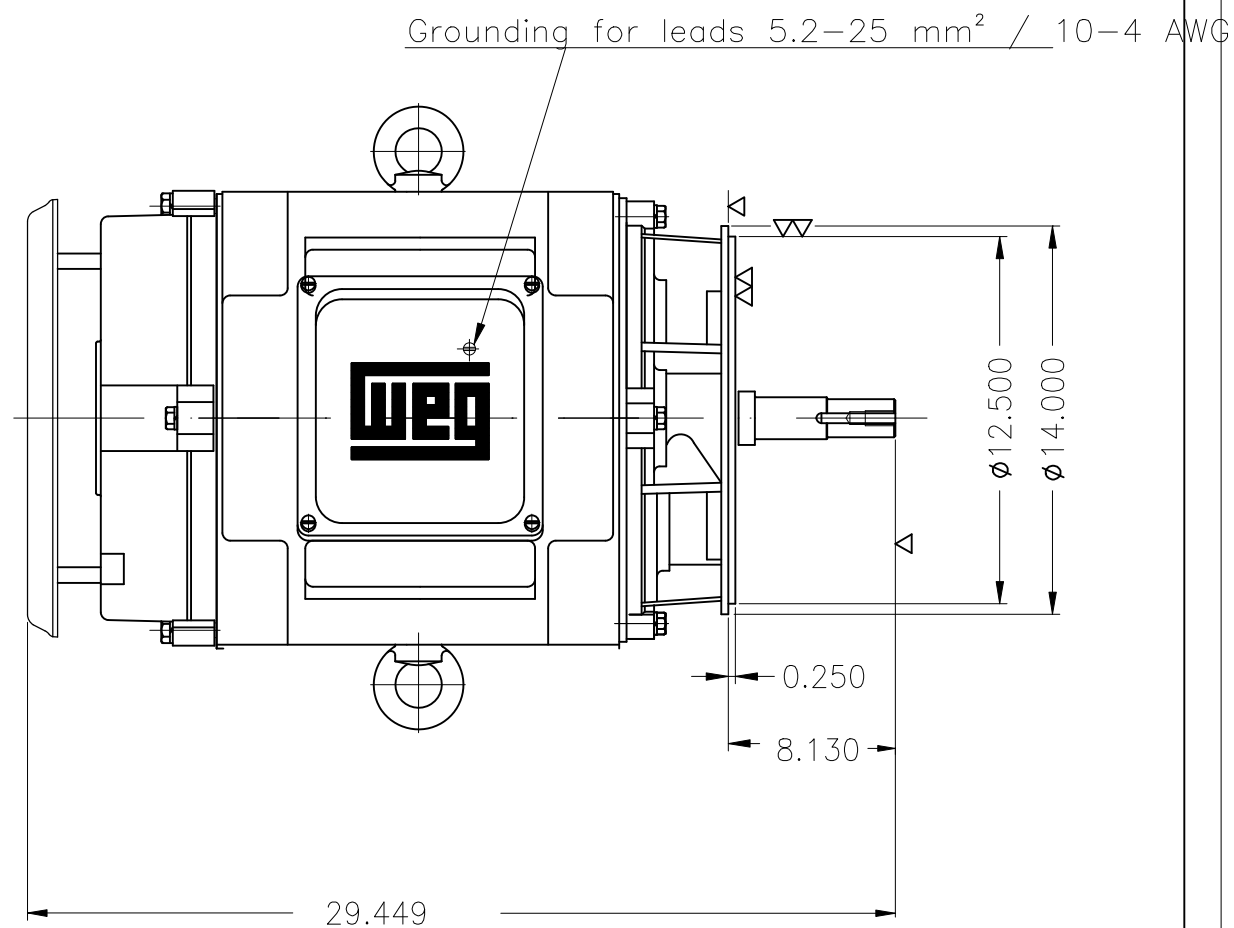


25 HP 04 Poles 60 Hz										A
				HYBRISUSER						00
ECM	LOC	SUMMARY OF MODIFICATIONS			EXECUTED	CHECKED	RELEASED	DATE	VER	
EXECUTED	HYBRISUSER		THREE PH. MOTOR JM/JP/JET PUMP HIGH EFF. FRAME 284JP IP23 ODP			PREVIEW WDD 00				
CHECKED										
RELEASED										
REL. DATE		WMO	Jaragua do Sul		Product Engineering	SHEET	1 / 1			

Dimensions in Inches

KME	A3
-----	----