
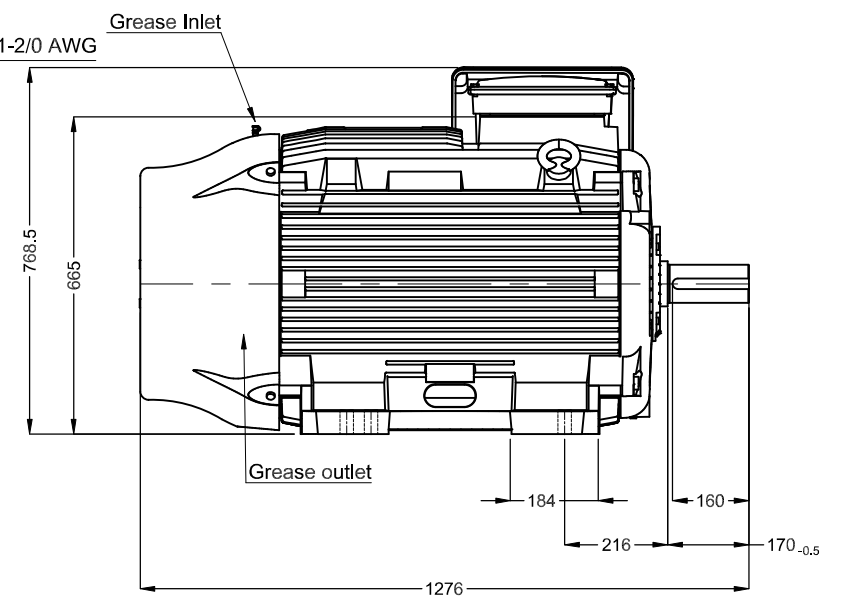
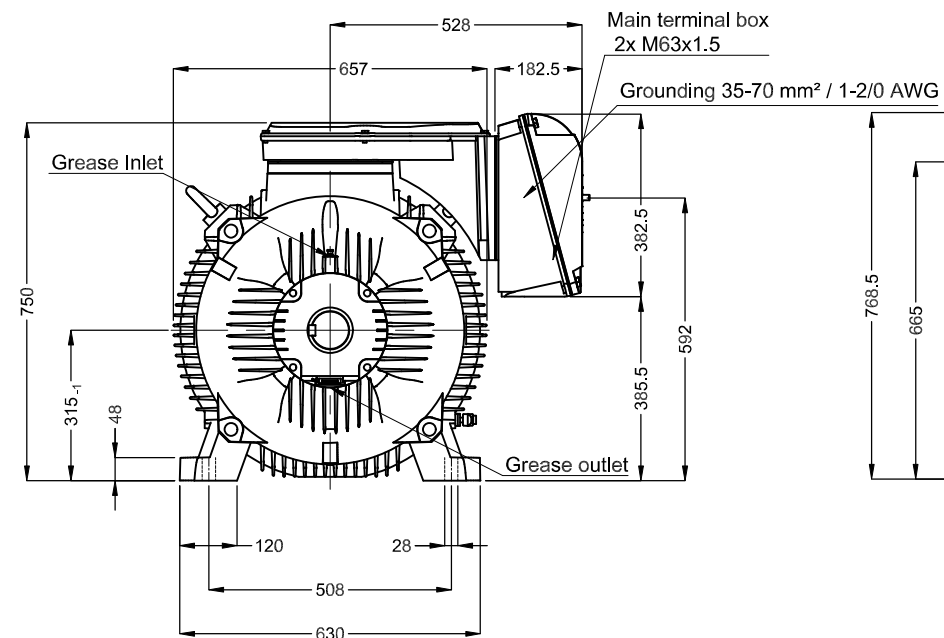


250 HP 04 Poles 60 Hz										A	
							HYBRISUSER			00	
ECM		LOC	SUMMARY OF MODIFICATIONS				EXECUTED	CHECKED	RELEASED	DATE	VER
EXECUTED	HYBRISUSER		THREE PH. MOTOR W22 IE3 FRAME 315S/M IP55 TEFC					PREVIEW WDD 00			
CHECKED											
RELEASED											
REL. DATE											
						SHEET		/			

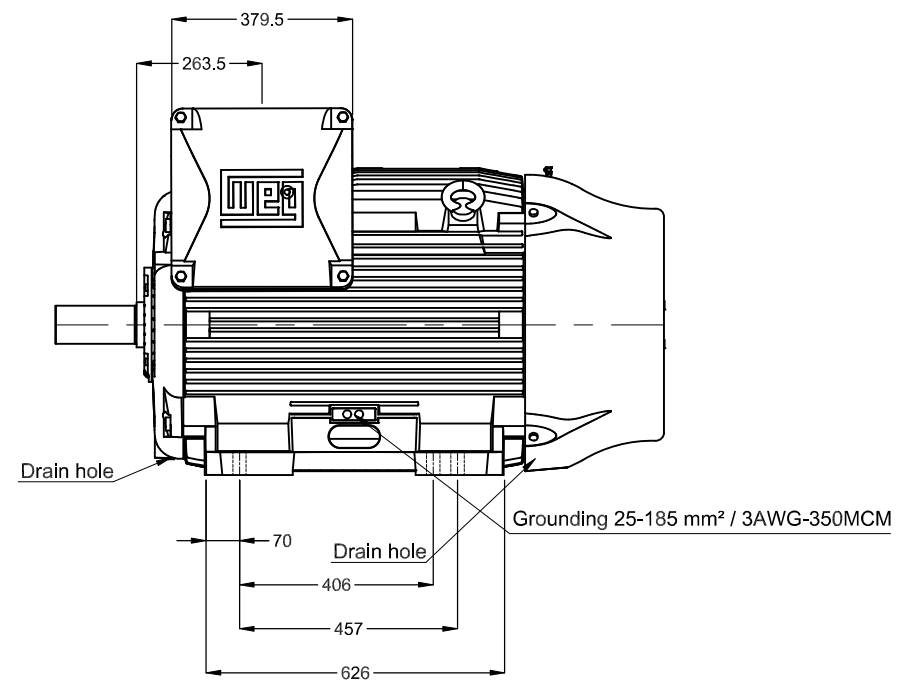