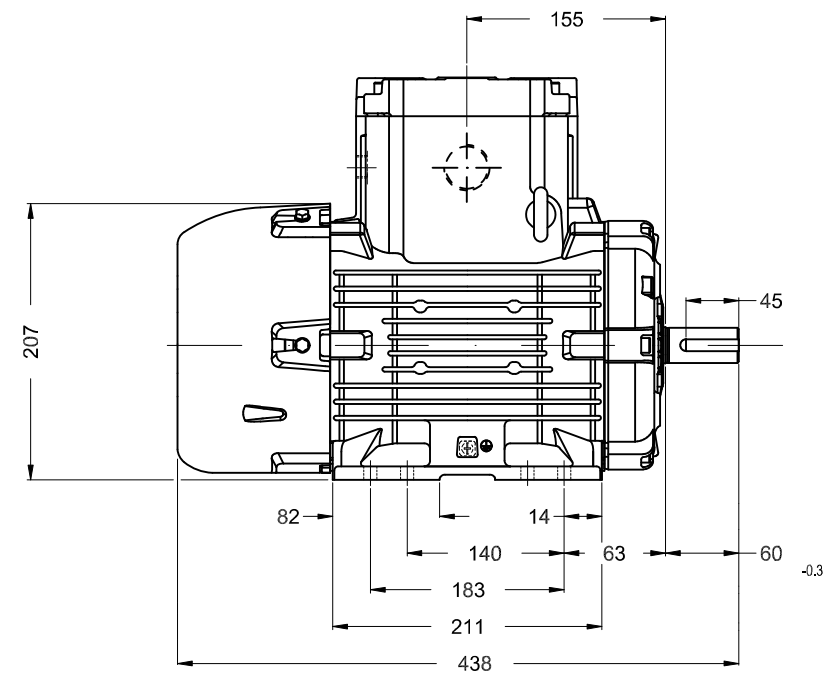


Mounting B3T

3 kW 04 Poles 50 Hz										A
					HYBRISUSER					00
ECM	LOC	SUMMARY OF MODIFICATIONS			EXECUTED	CHECKED	RELEASED	DATE	VER	
EXECUTED	HYBRISUSER		THREE PH. MOTOR W22Xdb IE3 FRAME 100L IP56 TEFC			PREVIEW WDD 00				
CHECKED										
RELEASED										
REL. DATE		WMO	Jaragua do Sul	Product Engineering	SHEET		1 / 1			